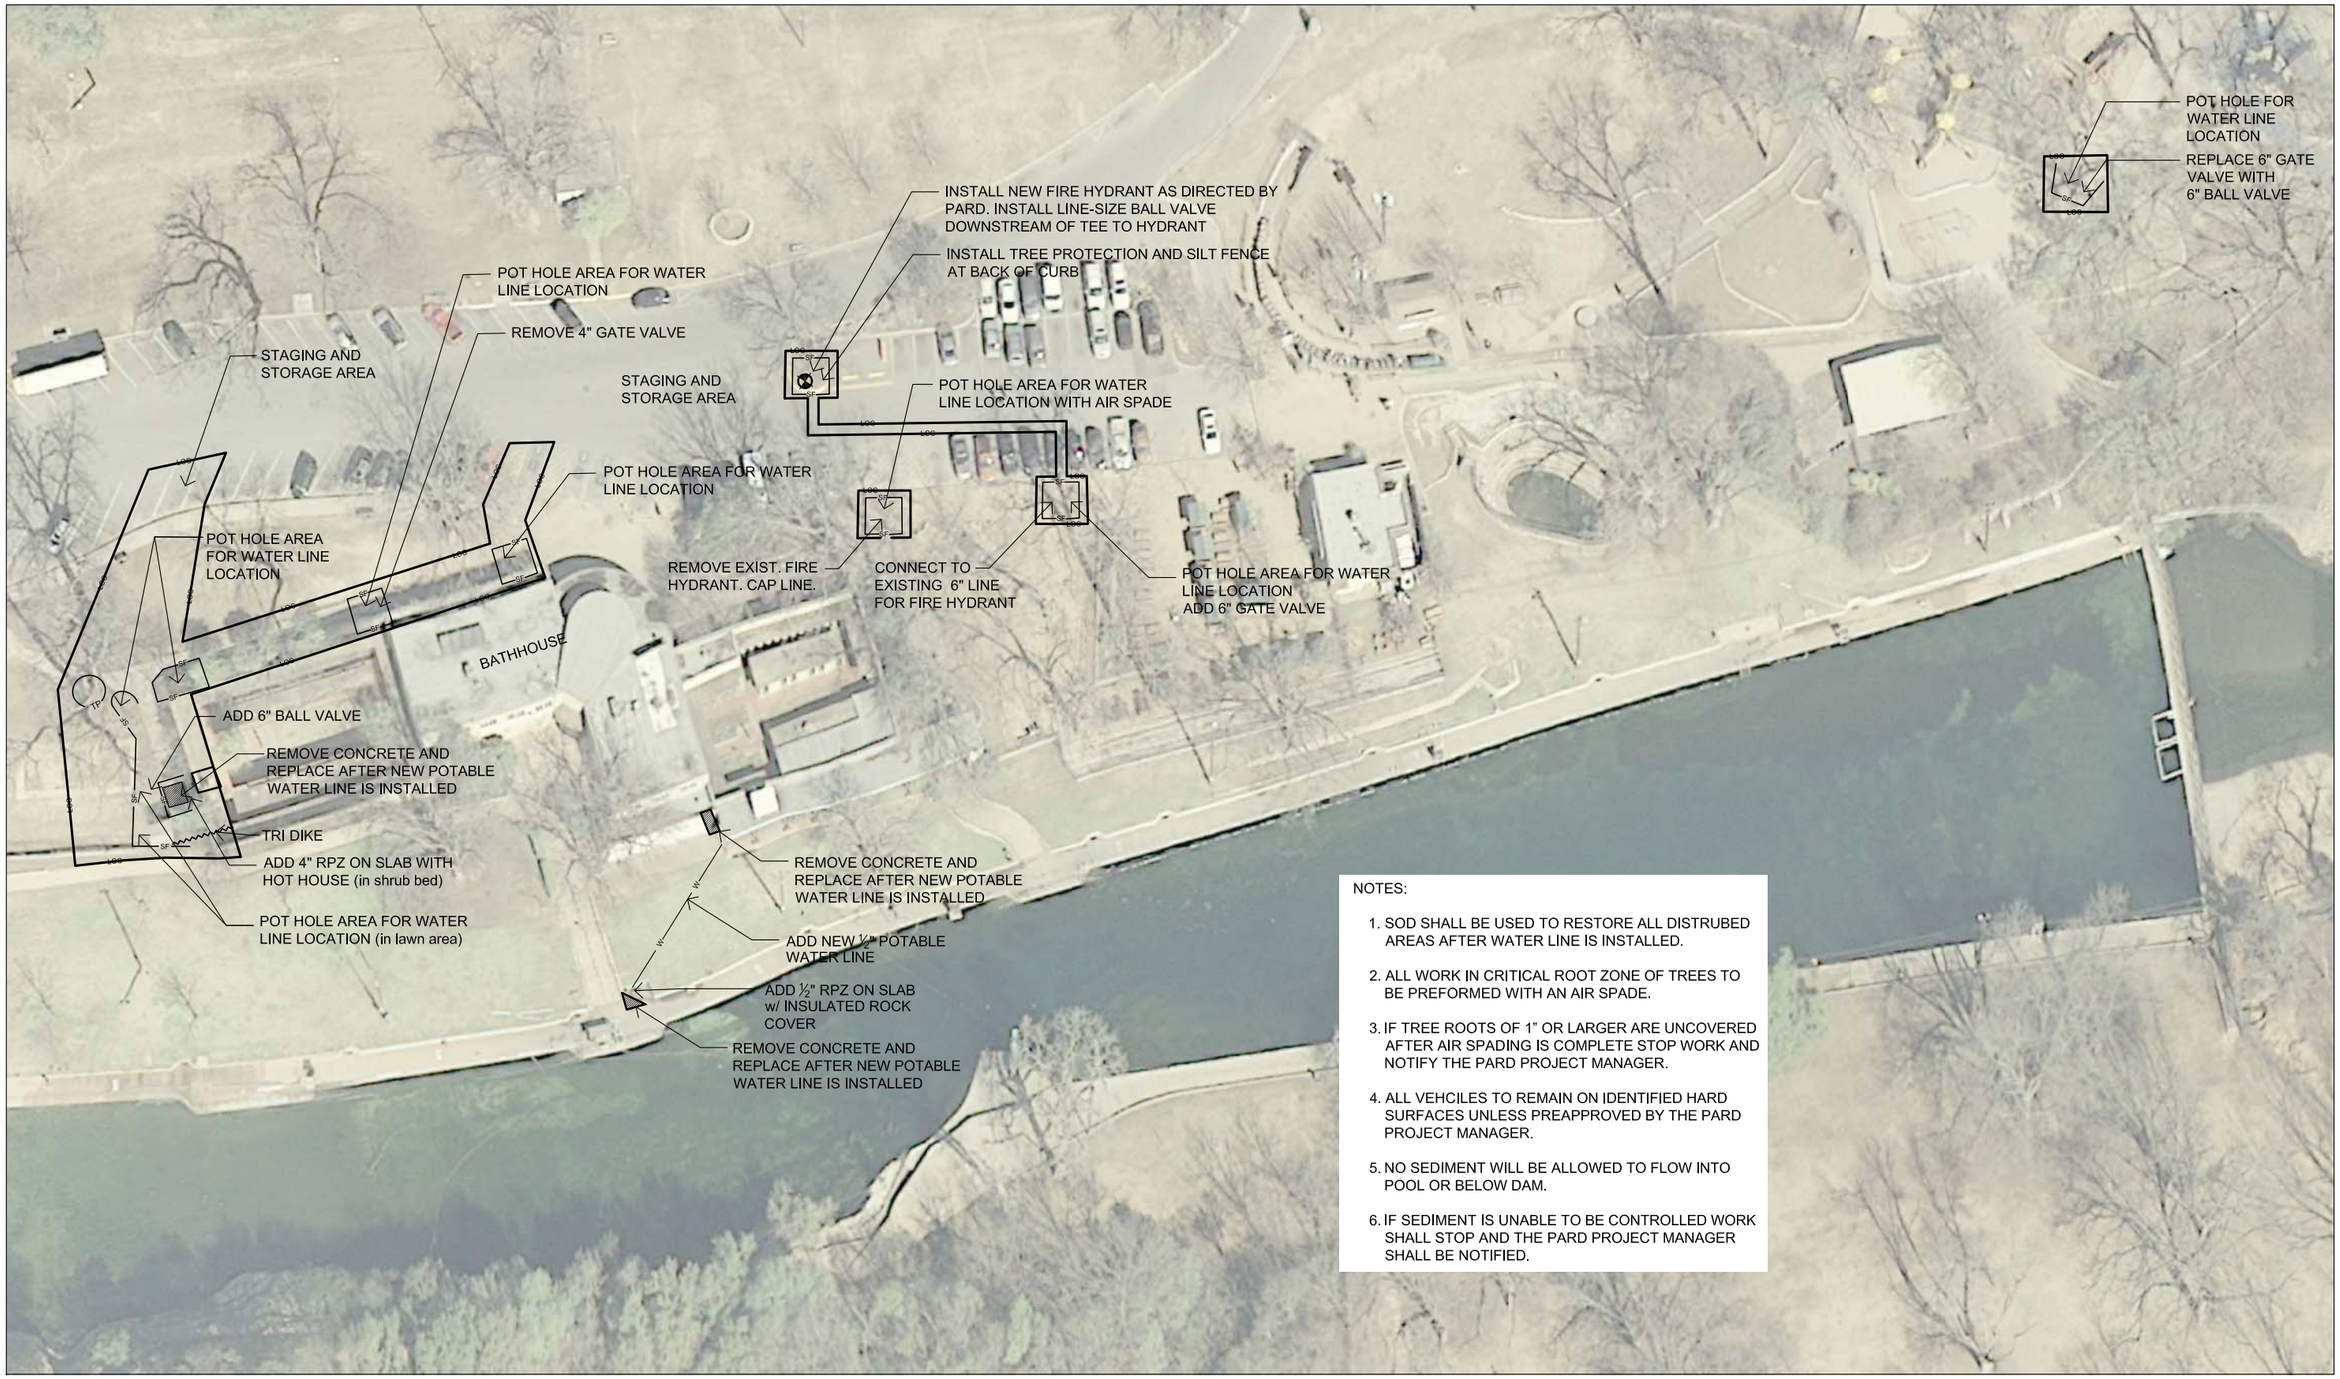

NOTES:

1. SOD SHALL BE USED TO RESTORE ALL DISTRUBED AREAS AFTER WATER LINE IS INSTALLED.
2. ALL WORK IN CRITICAL ROOT ZONE OF TREES TO BE PREFORMED WITH AN AIR SPADE.
3. IF TREE ROOTS OF 1" OR LARGER ARE UNCOVERED AFTER AIR SPADING IS COMPLETE STOP WORK AND NOTIFY THE PARD PROJECT MANAGER.
4. ALL VEHCILES TO REMAIN ON IDENTIFIED HARD SURFACES UNLESS PREAPPROVED BY THE PARD PROJECT MANAGER.
5. NO SEDIMENT WILL BE ALLOWED TO FLOW INTO POOL OR BELOW DAM.
6. IF SEDIMENT IS UNABLE TO BE CONTROLLED WORK SHALL STOP AND THE PARD PROJECT MANAGER SHALL BE NOTIFIED.

LEGEND

- SF — SILT FENCE
- W — WATER LINE
- TRI DIKE
- X — X — CHAIN LINK FENCE
- TP — TREE PROTECTION
- LOC — LIMITS OF CONSTRUCTION

SCALE IN FEET
0 30 60

NORTH

REGISTERED LANDSCAPE ARCHITECT
MARTY J. STUMP
2106
STATE OF TEXAS

BARTON SPRINGS POOL
WATER SUPPLY AND BACKFLOW PREVENTION (RPZ) IMPROVEMENTS PLAN

AUSTIN PARKS & RECREATION

DIRECTOR	Sara Hensley
ASSISTANT DIRECTOR	Kelly Snook
PLANNING DIVISION MANAGER	Ricardo Soliz
PROJECT MANAGEMENT SUPERVISOR	Marty Stump
LANDSCAPE ARCHITECT	Marty Stump

REVISIONS

APPROVED

DRAWN BY DS

SCALE	AS NOTED
DATE	09/13/11
SHEET	4 of 4
DWG	L1.1