

EROSION CONTROL NOTES

Appendix: P-1 (3/28/2011)

- The contractor shall install erosion/sedimentation controls and tree/natural area protective fencing prior to any site preparation work (cleaning, grubbing or excavation).
- The placement of erosion/sedimentation controls shall be in accordance with the Environmental Criteria Manual and the approved Erosion and Sedimentation Control Plan.
- The Placement of tree/natural area protective fencing shall be in accordance with the City of Austin standard Notes for Tree and Natural Area Protection and the approved Grading/Tree and Natural Area Plan.
- A pre-construction conference shall be held on-site with the contractor, design Engineer/permit applicant and Environmental Inspector after installation of the erosion/sedimentation controls and tree/natural area protection measures and prior to beginning any site preparation work. The contractor shall notify the Planning and Development Review Department, (512)974-2278, at least three days prior to the meeting date.
- Any major variation in materials or locations of controls or fences from those shown on the approved plans will require a revision and must be approved by the reviewing Engineer, Environmental Specialist or City Arboretist as appropriate. Major revisions must be approved by the Planning and Development Review Department. Minor changes to be made as field revisions to the Erosion and Sedimentation Control Plan may be required by the Environmental Inspector during the course of construction to correct control inadequacies.
- The contractor is required to inspect the controls and fences at weekly intervals and after significant rainfall events to insure that they are functioning properly. The person(s) responsible for maintenance of controls and fences shall immediately make any necessary repairs to damaged areas. Silt accumulation at controls must be removed when the depth reaches six (6) inches.
- Prior to final acceptance by the City, haul roads and waterway crossings constructed for temporary contractor access must be removed, accumulated sediment removed from the waterway and the area restored to the original grade and revegetated. All land clearing debris shall be disposed of in approved spoil disposal sites.
- All work must stop if a void in the rock substrate is discovered which is: one square foot in total area; blows air from within the substrate and/or consistently receives water during any rain event. At this time it is the responsibility of the Project Manager to immediately contact a City of Austin Environmental Inspector for further investigation.
- Temporary and Permanent Erosion Control: All disturbed areas shall be restored as noted below.

- A. All disturbed areas to be revegetated are required to place a minimum of six (6) inches of topsoil [see Standard Specification Item No. 601.5.3(A)]. Do not add topsoil within the critical root zone of existing trees. The topsoil shall be composed of 3 parts of soil mixed with 1 part compost, by volume. The compost shall be Dillo Dirt or an equal approved by the Engineer, or designated representative. The approved equal, if used, shall meet the definition of compost (as defined by TxDOT specification item 161). The soil shall be locally available native soil that meets the following specifications:
- Soil shall be free of trash, weeds, deleterious materials, rocks, and debris.
 - 100% shall pass through a 0.375-inch (3/8") screen.
 - Soil Texture class to be Loam, Sandy Clay Loam, or Sandy Loam in accordance with the USDA texture triangle. Soil known locally as "red death" or Austin Sandy Loam is not an allowable soil. Textural composition shall meet the following criteria:

Texture class	Minimum	Maximum
Clay	5%	25%
Silt	10%	50%
Sand	30%	80%

Topsoil salvaged from the existing site may often be used, but it should meet the same standards as set forth in these standards.

The vegetative stabilization of areas disturbed by construction shall be as follows:

TEMPORARY VEGETATIVE STABILIZATION:

- From September 15 to March 1, seeding shall be with cool season cover crops (Wheat at 0.5 pounds per 1000 SF, Oats at 0.5 pounds per 1000 SF, Cereal Rye Grain at 0.5 pounds per 1000 SF) with a total rate of 1.5 pounds per 1000 SF. Cool season cover crops are not permanent erosion control.
- From March 2 to September 14, seeding shall be with hulled Bermuda at a rate of 1 pound per 1000 SF.
 - Fertilizer shall be water soluble with an analysis of 15-15-15 to be applied once at planting and once during the period of establishment at a rate of 1/2 pound per 1000 SF.
 - Hydromulch shall comply with Table 1, below.
 - Temporary erosion control shall be acceptable when the grass has grown at least 1 1/2 inches high with 95% coverage, provided no bare spots larger than 16 square feet exist.
 - When required, native grass seeding shall comply with requirements of the City of Austin Environmental Criteria Manual.

Table 1: Hydromulching for Temporary Vegetative Stabilization

Material	Description	Longevity	Typical Applications	Application Rates
100% or any blend of wood, cellulose, straw, and/or cotton plant material (except no mulch shall exceed 30% paper)	70% or greater Wood/Straw 30% or less Paper or Natural Fibers	0-3 months	Moderate slopes; from flat to 3:1	1500 to 200 lbs per acre

PERMANENT VEGETATIVE STABILIZATION

- From September 15 to March 1, seeding is considered to be temporary stabilization only. If cool season cover crops exist where permanent vegetative stabilization is desired, the grasses shall be moved to a height of less than one-half (1/2) inch and the area shall be re-seeded in accordance with 2. below.
- From March 2 to September 14, seeding shall be with hulled Bermuda at a rate of 1 pound per 1000 SF with a purity of 95% with 85% germination. Bermuda grass is a warm season grass and is considered permanent erosion control.
 - Fertilizer shall be a water soluble with an analysis of 15-15-15 to be applied once at planting and once during the period of establishment at a rate of 1/2 pound per 1000 SF.
 - Hydromulch shall comply with Table 2, below.
 - The planted area shall be irrigated or sprinkled in a manner that will not erode the topsoil, but will sufficiently soak the soil to a depth of six inches. The irrigation shall occur at daily intervals (minimum) during the first two months. Rainfall occurrences of 1/2 inch or more shall postpone the watering schedule for one week. Permanent erosion control shall be acceptable when the grass has grown at least 1 1/2 inches high with 95% coverage, provided no bare spots larger than 16 square feet exist.
 - When required, native grass seeding shall comply with requirement of the City of Austin Environmental Criteria Manual.

Table 2: Hydromulching for Permanent Vegetative Stabilization

Material	Description	Longevity	Typical Applications	Application Rates
Bonded Fiber Matrix (BFM)	80% Organic defibrated fibers 10% Tackifier	6 months	On slopes up to 2:1 and erosive soil conditions	2500 to 4000 lbs per acre (see manufacturers recommendations)
Fiber Reinforced Matrix (FRM)	65% Organic defibrated fibers 25% Reinforcing Fibers or less 10% Tackifier	Up to 12 months	On slopes up to 1:1 and erosive soil conditions	3000 to 4500 lbs per acre (see manufacturers recommendations)

Developer Information:

Owner: Alan and Michelle Smith
Address: 1504 ROCKCLIFF ROAD, Austin, Texas 78746
Phone # (713) 452-2210

Owner's representative responsible for plan alterations:
ALAN SMITH
Phone # (713) 452-2210

Person or firm responsible for erosion/sedimentation control maintenance:
ALAN SMITH
Phone # (713) 452-2210

Person or firm responsible for tree/natural area protection maintenance:
ALAN SMITH
Phone # (713) 452-2210

The contractor shall not dispose of surplus excavated material from the site without notifying the Planning and Development Review Department at (512) 974-2278 at least 48 hours prior with the location and a copy of the permit issued to receive the material.


1504 ROCKCLIFF ROAD

OWNER:

ALAN AND MICHELLE SMITH
1504 ROCKCLIFF ROAD
AUSTIN, TEXAS 78746

ENGINEER:

BRUCE S. AUPPERLE, P.E.
AUPPERLE COMPANY
2219 WESTLAKE DR. STE. 110
AUSTIN, TEXAS 78746
PHONE (512) 422-7838
FAX (512) 329-8241

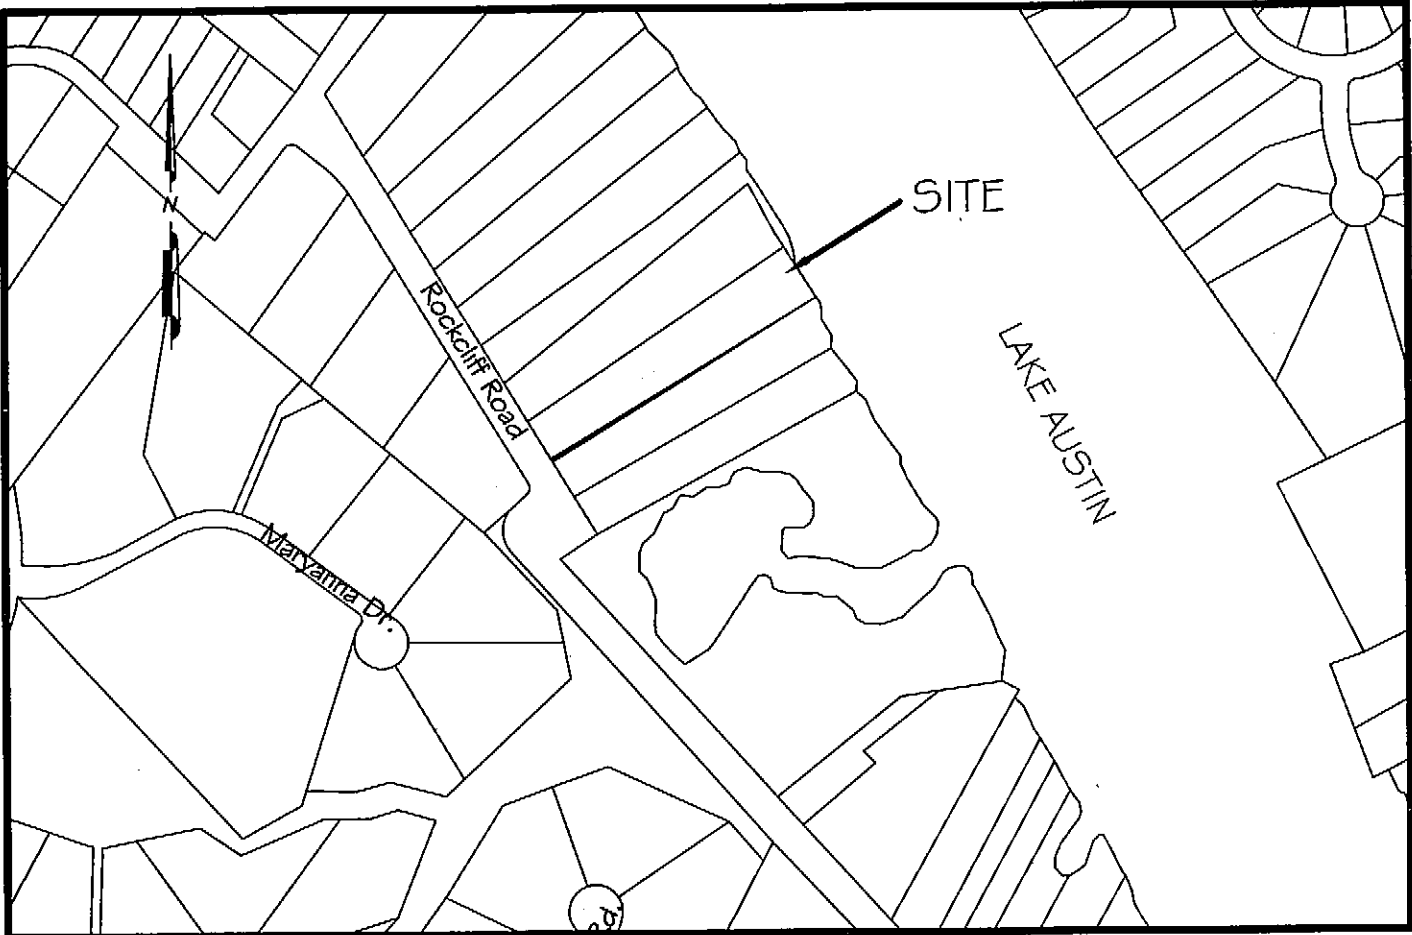

MAPSCO GRID A31
VICINITY MAP
1" = 360'

CITY OF AUSTIN STANDARD NOTES FOR TREE AND NATURAL AREA PROTECTION

Appendix: P-2 (3/28/2011)

- All trees and natural areas shown on plan to be preserved shall be protected during construction with temporary fencing.
- Protective fences shall be erected according to City of Austin Standards for Tree Protection.
- Protective fences shall be installed prior to the start of any site preparation work (cleaning, grubbing or grading), and shall be maintained throughout all phases of the construction project.
- Erosion and sedimentation control barriers shall be installed or maintained in a manner which does not result in soil build-up within tree drip lines.
- Protective fences shall surround the trees or group of trees, and will be located at the outermost limit of branches (drip line), for natural areas, protective fences shall follow the Limit of Construction line, in order to prevent the following:
 - Soil compaction in the root zone area resulting from vehicular traffic or storage of equipment or materials;
 - Root zone disturbances due to grade changes (greater than 6 inches cut or fill), or trenching not reviewed and authorized by the City Arboretist;
 - Wounds to exposed roots, trunk or limbs by mechanical equipment;
 - Other activities detrimental to trees such as chemical storage, cement truck cleaning, and fires.
- Exceptions to installing fences at tree drip-lines may be permitted in the following cases:
 - Where there is to be an approved grade change, impermeable paving surface, tree well, or other such site development, erect the fence approximately 2 to 4 feet beyond the area disturbed;
 - Where permeable paving is to be installed within a tree's drip-line, erect the fence at the outer limits off the permeable paving area (prior to site grading so that this area is graded separately prior to paving installation to minimize root damage);
 - Where trees are close to proposed buildings, erect the fence to allow 6 to 10 feet of work space between the fence and the building;
 - Where there are severe space constraints due to tract size, or other special requirements, contact the City Arboretist at 512-974-1876 to discuss alternatives.

SPECIAL NOTES: For the protection of natural areas, no exceptions to installing fences at the Limit of Construction line will be permitted.

- Where any of the above exceptions result in a fence being closer than 4 feet to a tree trunk, protect the trunk with strapped-on plank to a height of 8 feet (or to the limits of lower branching) in addition to the reduced fencing provided.
- Trees approved for removal shall be removed in a manner which does not impact trees to be preserved.
- Any roots exposed by construction activity shall be pruned flush with the soil. Backfill root areas with good quality top soil as soon as possible. If exposed root areas are not backfilled within 2 days, cover them with organic material in a manner which reduces soil temperature and minimizes water loss due to evaporation.
- Any trenching required for the installation of landscape irrigation shall be placed as far from existing tree trunks as possible.
- No landscape topsoil dressing greater than 4 inches shall be permitted within the drip-line of trees. No soil is permitted on the root flare of any tree.
- Pruning to provide clearance for structures, vehicular traffic and equipment shall take place before damage occurs (nipping of branches, etc.).
- All finished pruning shall be done according to recognized, approved standards of the industry (Reference the National Arborist Association Pruning Standards for Shade Trees available on request from the City Arboretist).
- Deviations from the above notes may be considered ordinance violations if there is substantial non-compliance or if a tree sustains damage as a result.

STANDARD SEQUENCE OF CONSTRUCTION

Appendix: P-4 (3/28/2011)

The following is a sequence of construction shall be used for all development.

- Temporary erosion and sedimentation controls are to be installed as indicated on the approved site plan. Install tree protection and initiate tree mitigation measures. (as needed)
- Install natural area protection. (as required)
- The Environmental Project Manager or Site Supervisor must contact the Planning & Development Review Department, Environmental Inspection, at (512) 974-2278, 72 hours prior to the scheduled date of the required on-site preconstruction meeting.
- A pre-construction meeting with Environmental Inspector is required prior to any site disturbance.
- Temporary erosion and sedimentation controls will be revised, if needed, to comply with City Inspectors' directives, and revised construction schedule relative to the erosion plan.
- Demolish existing boat dock. Construction access from water.
- Begin boat dock construction activities. Construction access from water.
- Complete construction and start revegetation of the site and installation of landscaping.
- Upon completion of the site construction and revegetation of a project site, the design engineer shall submit an engineer's letter of concurrence to the Planning & Development Review Department indicating that construction, including revegetation, is complete and in substantial conformity with the approved plans. After receiving this letter, a final inspection will be scheduled by the appropriate City Inspector.
- Obtain final inspection release once vegetation has 95% coverage.
- After a final inspection has been conducted by the City Inspector and with approval from the City Inspector, remove the temporary erosion and sedimentation controls and complete any necessary final revegetation resulting from removal of the controls.

REMEDIAL TREE CARE NOTES AERATION AND SUPPLEMENTAL NUTRIENT REQUIREMENTS FOR TREES

Appendix: P-6 (12/20/2002)

Trees will be Aerated and Provided Nutrients Prior to any Construction Activity.

As a condition of final acceptance of the site, and in conformance with Environmental Criteria Manual section 3.5.4 - All preserved trees within the limits of construction will be Aerated and provided with Supplemental Nutrients per the following guidelines. Macro and MicroNutrients are required, Humate/nutrient solutions with mycorrhizae components are highly recommended. These solutions are commonly utilized to provide remediation for trees affected by construction. Materials and methods are to be approved by the City Arboretist (512)974-1876 prior to application. The owner or general contractor shall select a fertilization contractor and insure coordination with the City Arboretist Phone: (512)974-1876.

Treatment is to commence prior to the beginning of construction activities and again after the completion of all construction. Areas to be treated include the entire critical root zone of trees as depicted on the City approved plans. Trees are to be aerated by water injected into the soil (under pressure via a soil probe at 50-125 pounds per square inch) or by other method as approved by Planning and Development Review Department. The Proposed Nutrient Mix Specifications need to be provided to and approved by the City Arboretist Prior to application Fax # (512)974-3010. Applicants may also specify soil injection of Doggett X-1 injecto 32-7-7 or equivalent at recommended rates. Construction which will be completed in less than 90 days should use materials at 1/2 recommended rates. Alternative organic fertilizer materials are acceptable when approved by the City Arboretist. Within 7 days after fertilization is performed, the contractor shall provide documentation of the work performed to the City Arboretist, Planning and Development Review Department P.O. Box 1088, Austin, Texas 78767. This Note should be referenced as item #1 in the Sequence of Construction.

GENERAL NOTES:

- This project is not located over the Edwards Aquifer recharge zone.
- Deed restrictions or restrictive covenants are applicable to this property.
- A business or living quarter may not be constructed on a pier or similar structure extending into or above Lake Austin, except under a license agreement approved by the council.
- Contractor to verify utility locations and ground and flow line elevations before construction.
- Environmental Inspector has the authority to add and/or modify erosion/sedimentation controls on site to keep project in-compliance with the City of Austin Rules and Regulations.
- Approval of these plans by the City of Austin indicates compliance with applicable City regulations only.
- Approval by other government entities may be required prior to the start of construction. The applicant is responsible for determining what additional approvals may be necessary.
- All work on this project is to be accomplished via barge. There will be no site access by land, nor any construction staging or materials storage be located on land.
- The proposed boat dock must comply with all requirements of LDC 25-2-1174 (Structural Requirements), and must comply with Chapter 25-12, Article 1 (Uniform Building Code) and the Building Criteria Manual.

Site Plan Release Notes:

The following site plan release notes are included in accordance with the City of Austin's request. Applicant will comply with all applicable City of Austin requirements.

- All improvements shall be made in accordance with the released site plan. Any additional improvements will require site plan amendment and approval of the Planning & Development Review Department.
- All signs must comply with requirements of the Land Development Code. (Section 13-2, Article VII)
- Additional electric easements may be required at a later date.
- All existing structures shown to be removed will require a demolition permit from the City of Austin Planning & Development Review Department.
- A development permit must be issued prior to an application for building permit for non-consolidated or Planning Commission approved site plans.
- For driveway construction: The owner is responsible for all costs for relocation of, or damage to utilities.
- For construction within the right-of-way, a concrete permit is required.
- For the building permit, a signed and sealed letter shall be submitted to the City of Austin, per the Land Development Code, 25-12-3 1612.4, certifying that the structure is in accordance with ASCE 24, Flood Resistant Design and Construction.
- All work will occur within the limits of construction as shown on the plan, and that no materials or equipment will be delivered to the site from the landward side of this project.

10. Approval of this Site Plan does not include Building and Fire Code approval nor building permit approval.

All responsibility for the adequacy of these plans remain with the engineer who prepared them. In approving these plans, the City of Austin must rely upon the adequacy of the work of the design engineer.

REVISIONS / CORRECTIONS

NO.	DESCRIPTION	REVISE (R) ADD (A) VOID (V) SHEET NO. 5	TOTAL # SHEETS IN PLAN SET	NET CHANGE IMP. COVER (SQ. FT.)	TOTAL SITE IMP. COVER (SQ. FT.)	CITY OF AUSTIN APPROVAL DATE	DATE IMAGED

No vegetation within the shoreline setback area shall be removed before the issuance of a building permit, except as may be required for surveying and testing. Areas cleared for surveying or testing shall be no more than 15 feet wide and no trees of six inches or more in diameter shall be removed for surveying or testing.

All areas disturbed within the shoreline setback shall be restored in accordance with City of Austin specifications.

All disturbed areas shall be restored as noted in erosion control & restoration notes.

WATERSHED STATUS: This site is located in LAKE AUSTIN watershed, is classified as a WATER SUPPLY RURAL watershed, and shall be developed, constructed and maintained in conformance with Chapter 25 of the Land Development Code.

SMART GROWTH ZONE: Drinking Water Protection Zone

FLOODPLAIN INFORMATION: This project is within the 100-year flood plain as shown on the F.E.M.A. panel 48453C0435H effective 26SEP2008.

LEGAL DESCRIPTION: Lot 1 Blk 1 Evans Addition, Deed Doc. #2010165317, Vol. 97, Pg. 38

PROJECT ADDRESS: 1504 ROCKCLIFF ROAD, AUSTIN, TX 78746

ZONING: LA

USE: Single-Family Residence

RELATED PERMIT NUMBERS: SP-95-0433DS, CB-96-0065.0A

Release of this application does not constitute a verification of all data, information and calculations supplied by the applicant. The engineer of record is solely responsible for the completeness, accuracy and adequacy of higher submittal, whether or not the application is reviewed for Code compliance by City engineers.

Site Plan subject to City of Austin Watershed Protection Regulations.

Plan Sheet List

- COVER SHEET & NOTES
- SITE PLAN
- DOCK ELEVATIONS
- DOCK PLAN

Approved By:

Parks & Recreation Date

For Director - Planning & Development Review Department Date

SP-2012-0186DS


Permit Number

June 1, 2012

Submittal Date

June 1, 2015

Project Duration Date

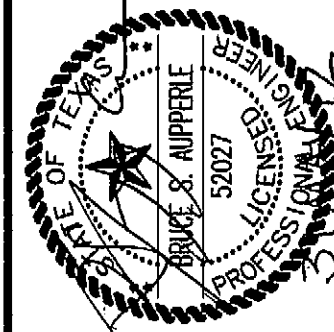


AUPPERLE COMPANY
Engineering, Planning & Development Services
10088 Circleview Drive, Austin, Texas 78733 512.329.8241
Texas Board Of Professional Engineers Registration Number E-1899

1504 ROCKCLIFF ROAD

COVER SHEET & NOTES

DESIGNED: BSA
APPROVED:
SCALE: NTS
1504 Rockcliff Road
DATE: June , 2012
SHEET 1 of 2


1504 ROCKCLIFF ROAD

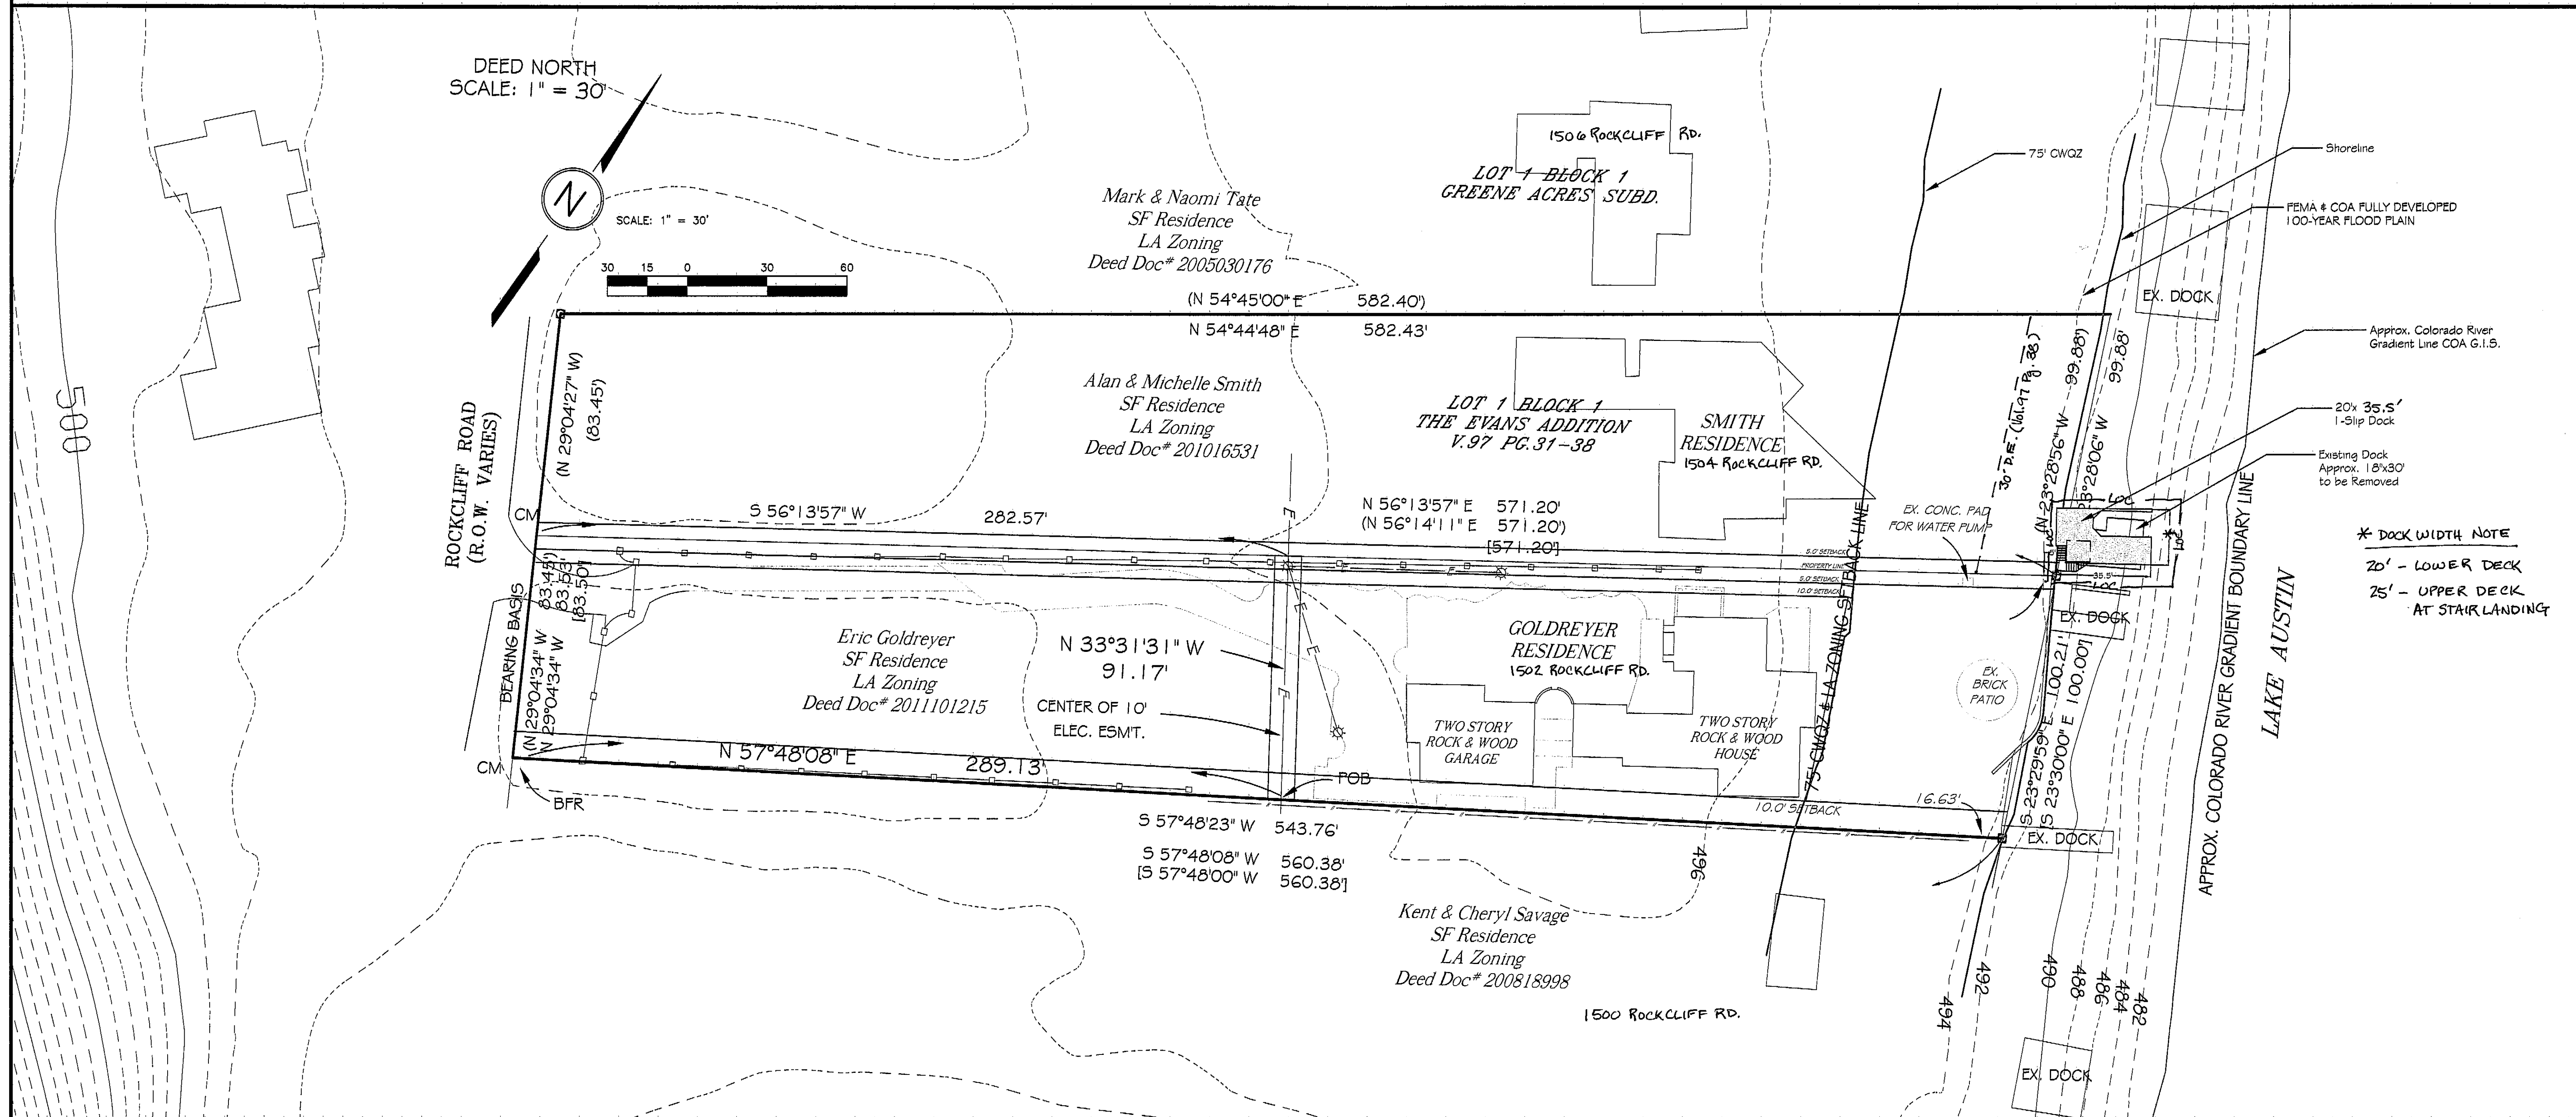

NOTES:


1. A DOCK MUST BE CONTINUOUSLY LIGHTED WITH AMBER LIGHTS BETWEEN SUNSET AND SUNRISE EACH DAY.
2. A DOCK MUST HAVE AT LEAST TWO LIGHT STATIONS. THE LIGHT STATION MUST BE LOCATED ON THE END OF THE DOCK AND ON THE SIDE THAT IS FARTHEST FROM AND PARALLEL TO THE SHORELINE. THE LIGHT MUST BE VISIBLE TO A PROPERLY APPROACHING WATERCRAFT.
3. NAVIGATION LIGHTS MUST HAVE A TWO-BULB FIXTURE, WITH TWO WORKING LIGHT BULBS RATED BETWEEN 7-1/2 AND 25 WATTS INCLUSIVE. LIGHT BULBS OR BULB COVERS MUST BE AMBER, AND WHITE LIGHT MAY NOT RADIATE FROM THE FIXTURE. WEATHERPROOF LAMP HOLDERS AND JUNCTION BOXES ARE REQUIRED. EACH LIGHT FIXTURE MUST BE WIRED WITH A SWITCH OPERATED BY A PHOTOELECTRIC CELL SO THAT THE LIGHTS WILL OPERATE AUTOMATICALLY DURING THE HOURS THAT THE DOCK IS REQUIRED TO BE LIGHTED.
4. ACCORDING TO THE TEXAS PARKS AND WILDLIFE, THE TEXAS COURTS HAVE ADOPTED THE "GRADIENT BOUNDARY" AS THE USUAL DIVIDING LINE BETWEEN PUBLIC OWNERSHIP OF A STREAMS BED AND LOWER BANK AREA, AND PRIVATE OWNERSHIP OF THE HIGHER BANK AREA AND THE UPLANDS BEYOND. SURVEYING THE GRADIENT BOUNDARY IS A COMPLEX TASK PERFORMABLE ONLY BY SPECIALLY TRAINED PERSONS. ACCORDING TO THE CITY OF AUSTIN AN APPROXIMATE DETERMINATION OF THE GRADIENT BOUNDARY ALONG LAKE AUSTIN IS THE 482' CONTOUR.
5. ALL WORK SHALL OCCUR WITHIN THE LIMITS OF CONSTRUCTION AS SHOWN ON THE PLAN, AND THAT NO MATERIALS OR EQUIPMENT WILL BE DELIVERED TO THE SITE FROM THE LANDWARD SIDE OF THIS PROJECT.
6. NO SHORELINE IMPROVEMENTS, EXCEPT GANGWAY & STAIR ACCESS OVER SHORELINE EDGE, ARE AUTHORIZED WITH THIS SITE PLAN. SHORELINE EDGE TO REMAIN UNDISTURBED.
7. NO TREES GREATER THAN 8' IN DIAMETER WILL BE IMPACTED BY THE PROPOSED DOCK CONSTRUCTION.
8. CONTAINERS OF HAZARDOUS MATERIALS, FUEL, OIL, HERBICIDES, INSECTICIDES, FERTILIZERS OR OTHER POLLUTANTS MAY NOT BE STORED ON DOCKS EXTENDING INTO OR ABOVE LAKE AUSTIN.
9. THE PROPOSED BOAT DOCK MUST COMPLY WITH ALL REQUIREMENTS OF LDC 25-2-1174 (STRUCTURAL REQUIREMENTS), AND MUST COMPLY WITH CHAPTER 25-1-2, ARTICLE 1 (UNIFORM BUILDING CODE) AND THE BUILDING CRITERIA MANUAL.

Existing Shoreline Length = 99.88'
Allowable Dock Width = 20% of 99.88' = 20'
Proposed Dock Width = * (See dock width note)
Existing Dock Depth = 30'
Proposed Dock Depth = 35.5'
Proposed Side Yard Offset = 5'

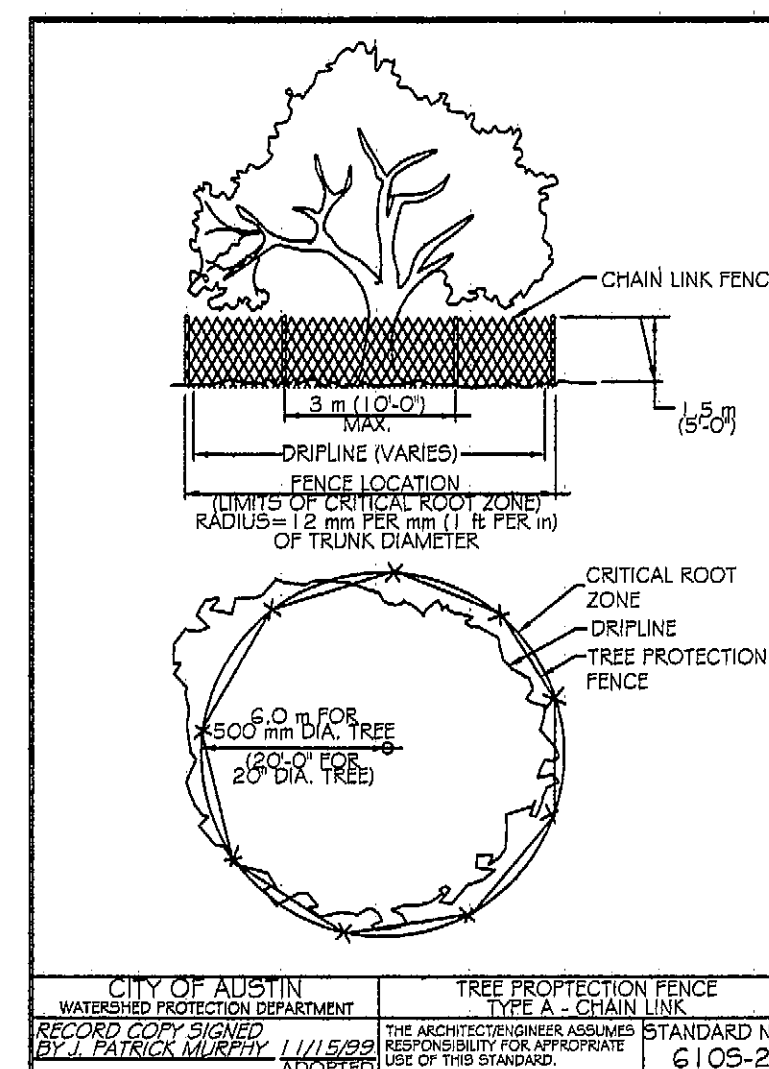

ATTENTION INSPECTOR NOTES:

1. COMPLIANCE WITH BUILDING CODE IS REQUIRED AND IS TO BE REVIEWED FOR COMPLIANCE DURING BUILDING CODE REVIEW.
2. FOR THE BUILDING PERMIT, A SIGNED AND SEALED LETTER SHALL BE SUBMITTED TO THE CITY OF AUSTIN, PER THE LAND DEVELOPMENT CODE, 25-12-3 1612.4, CERTIFYING THAT THE STRUCTURE IS IN ACCORDANCE WITH ASCE 24, FLOOD RESISTANT DESIGN AND CONSTRUCTION.

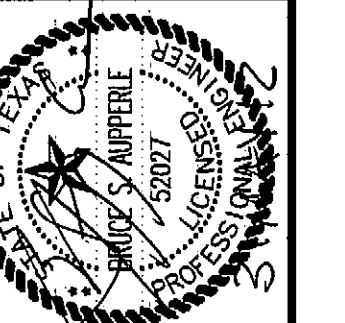


AUPPERLE COMPANY
Engineering, Planning & Development Services
2219 Westlake Drive #100, Austin, Texas 78746 512 329-8241
Texas Board of Professional Engineers Registration Number F-1994


1504 ROCKCLIFF ROAD
SITE PLAN

DESIGNED: BSA
APPROVED:
SCALE: NTS
1504 ROCKCLIFF ROAD
DATE: June , 2012
SHEET 2 of 4


□

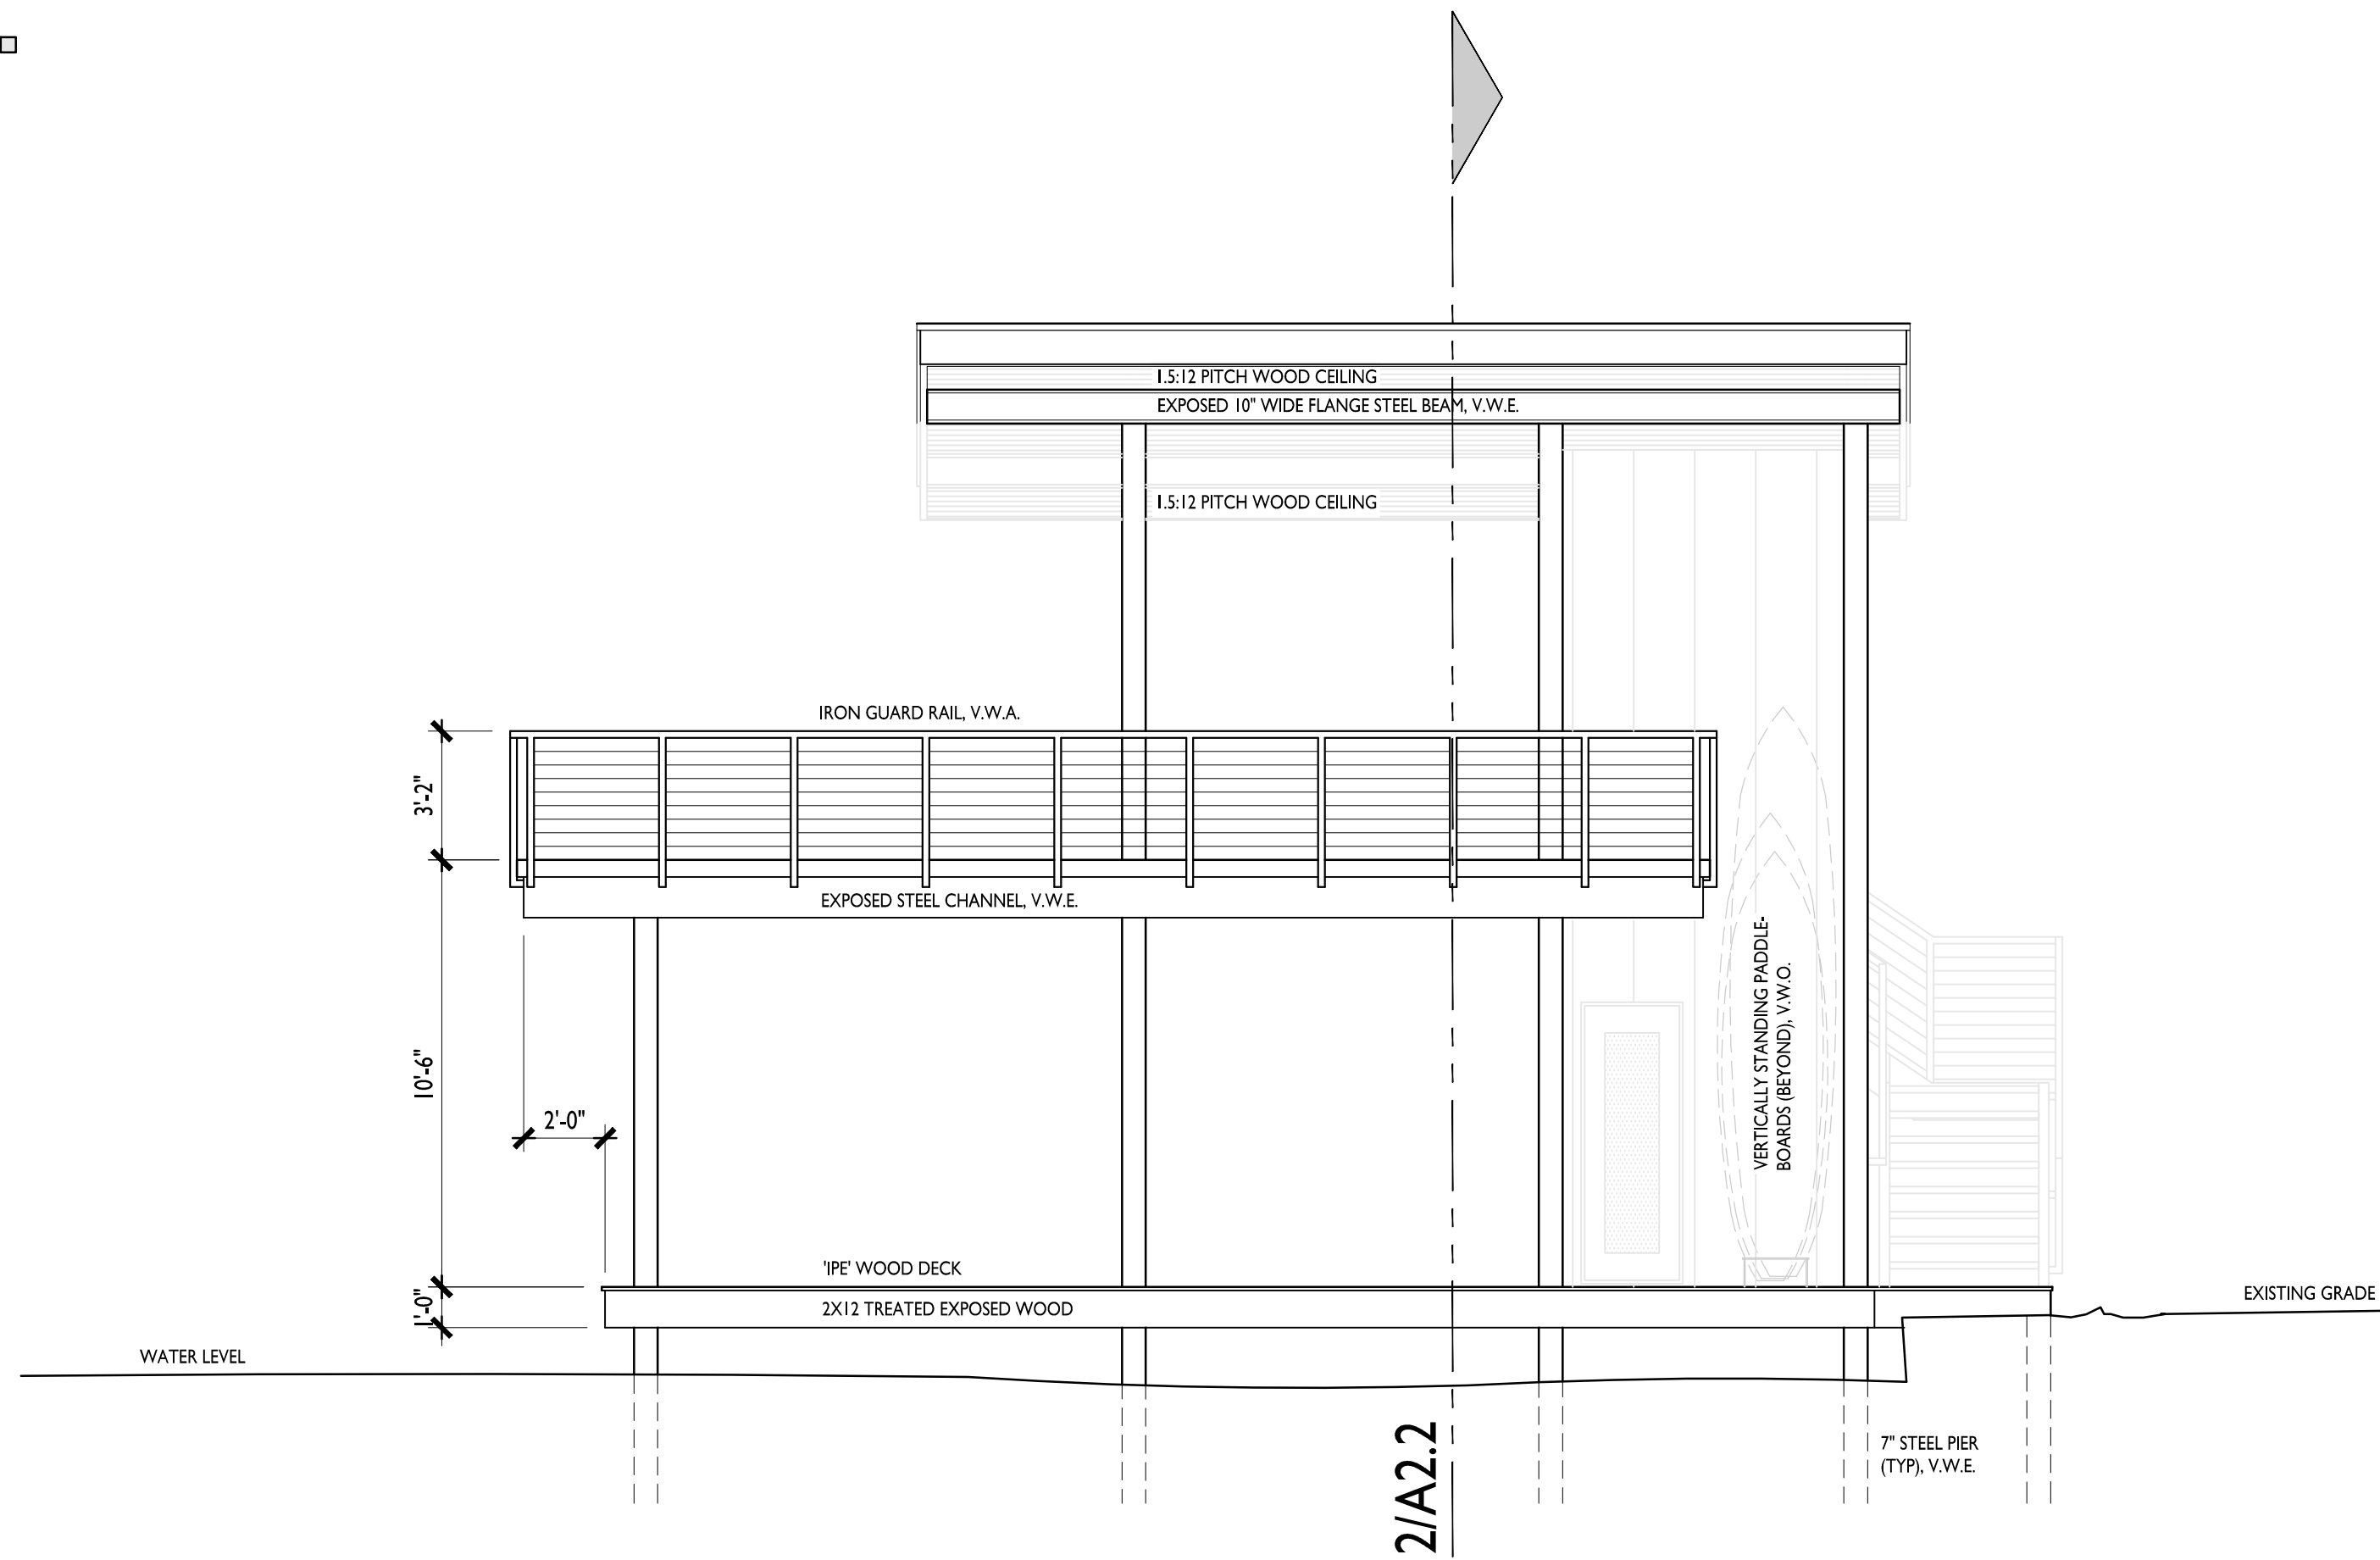


1. right side elevation

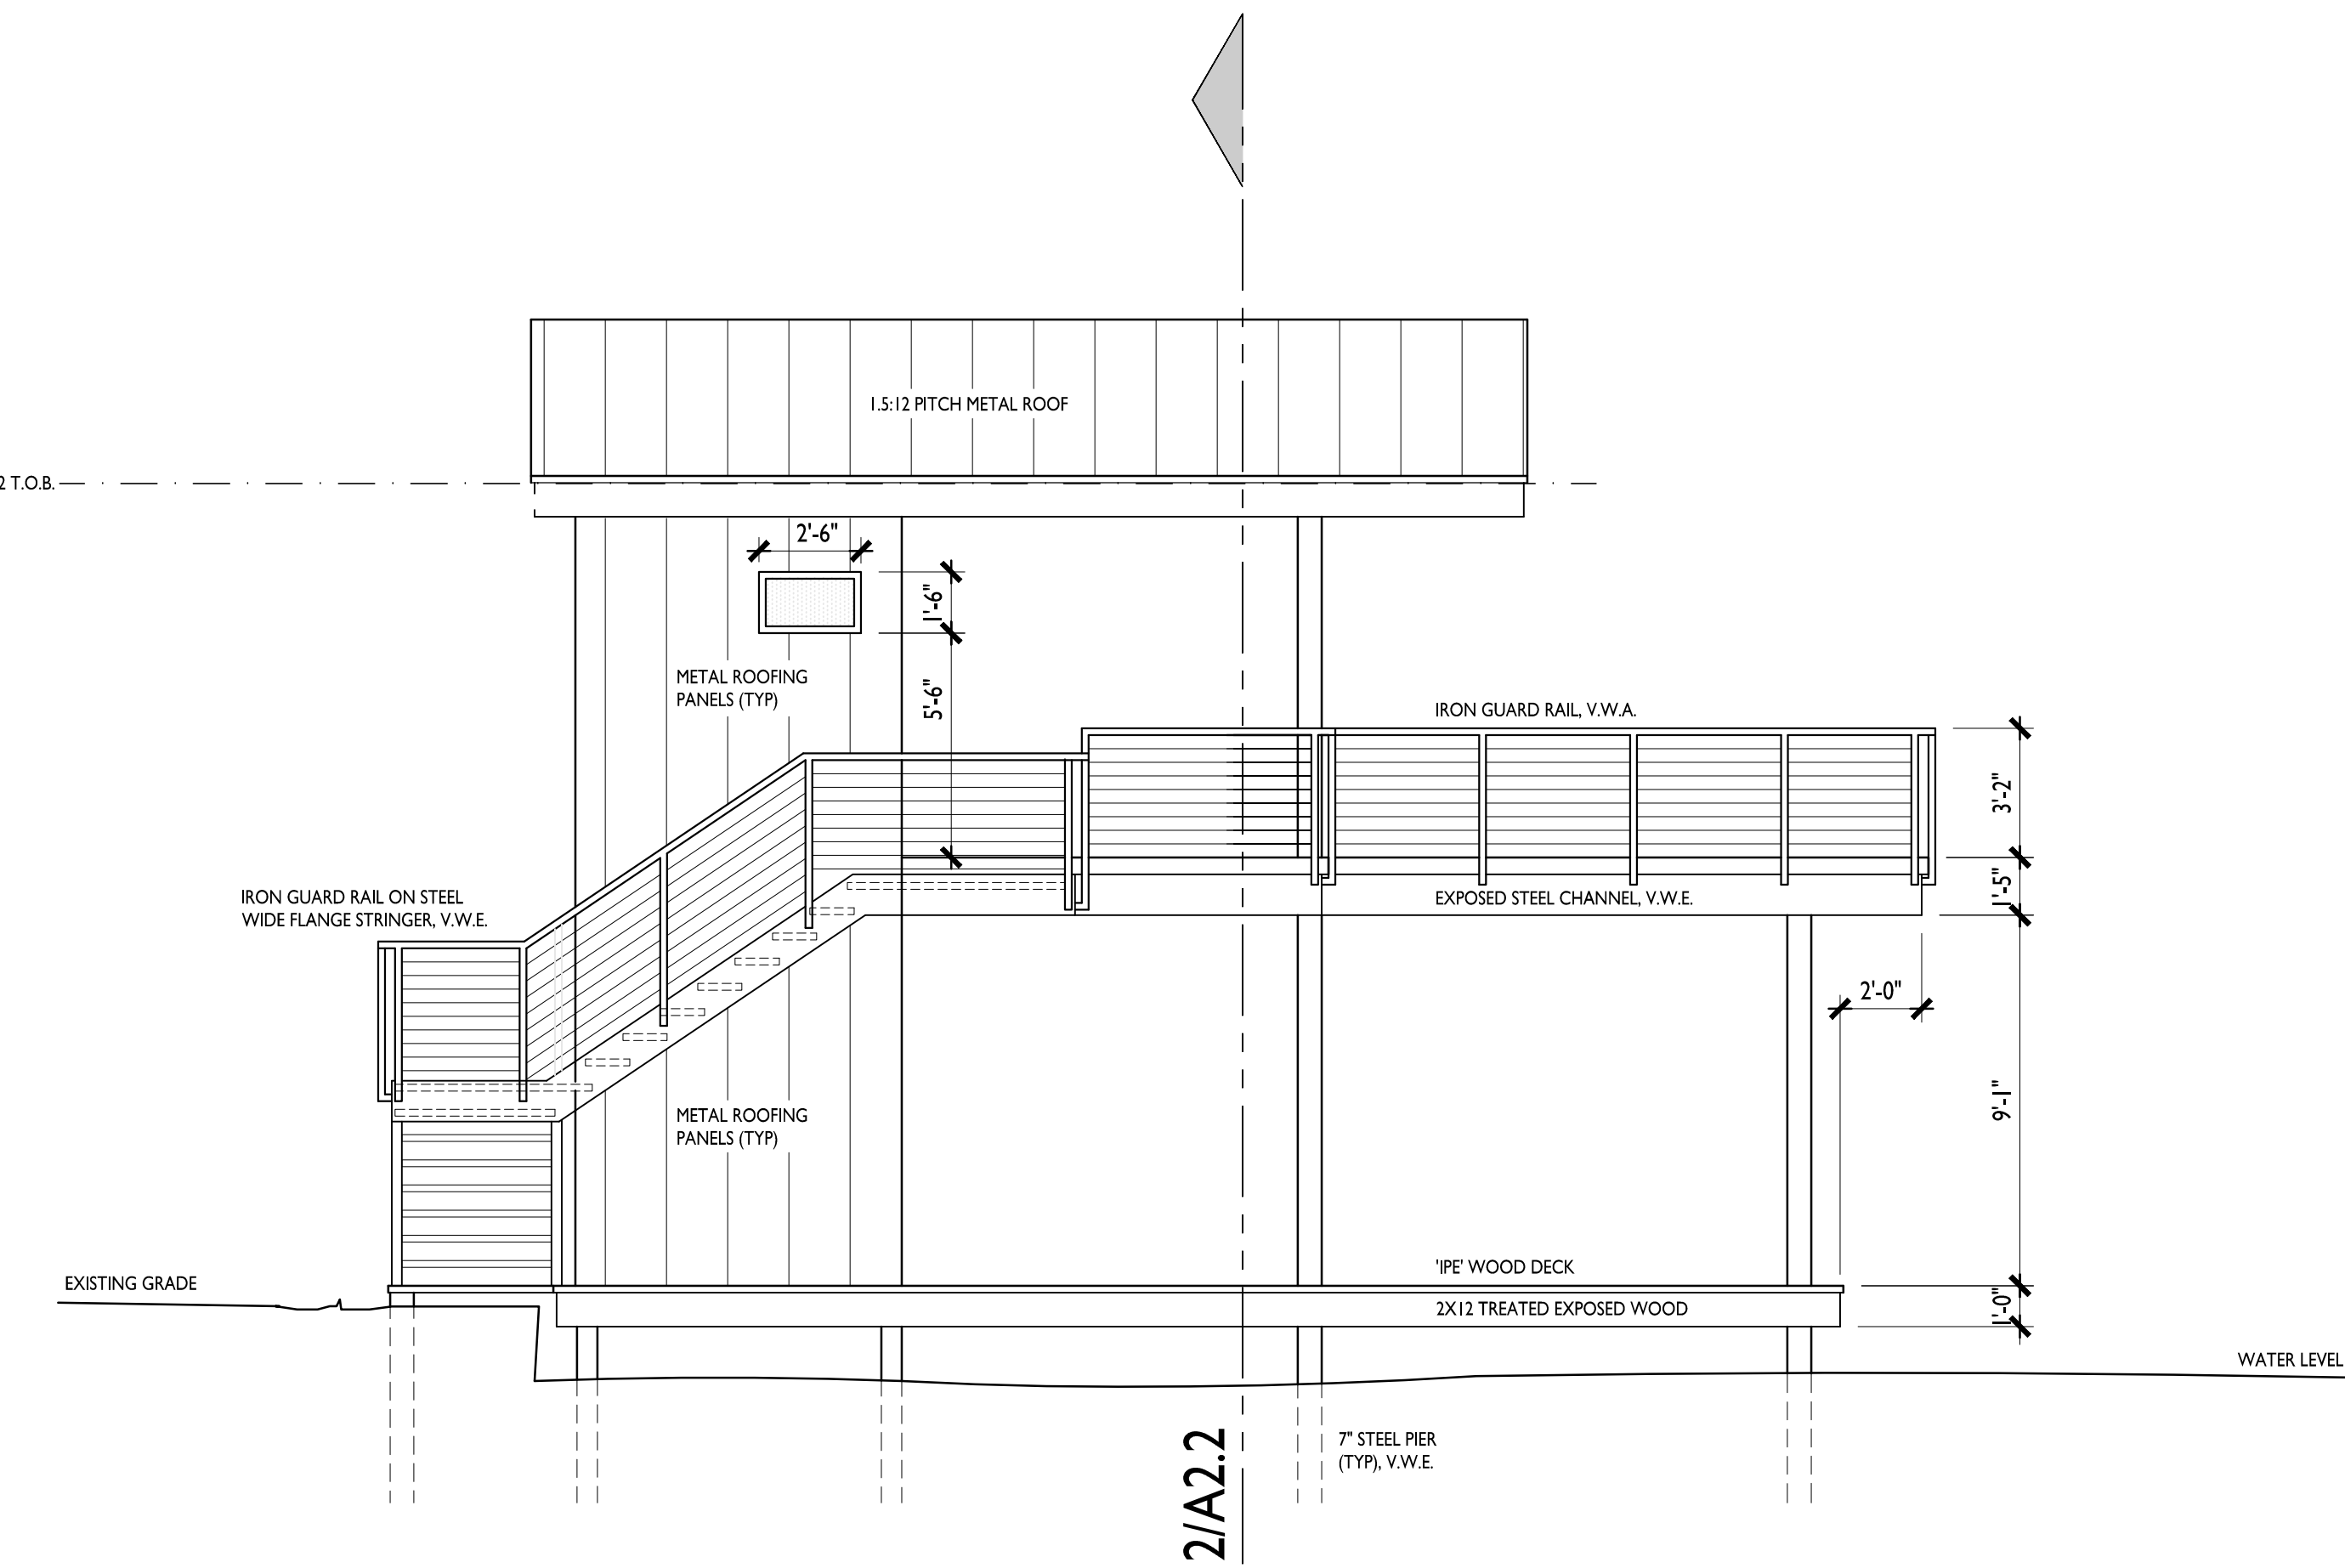

2. left side elevation

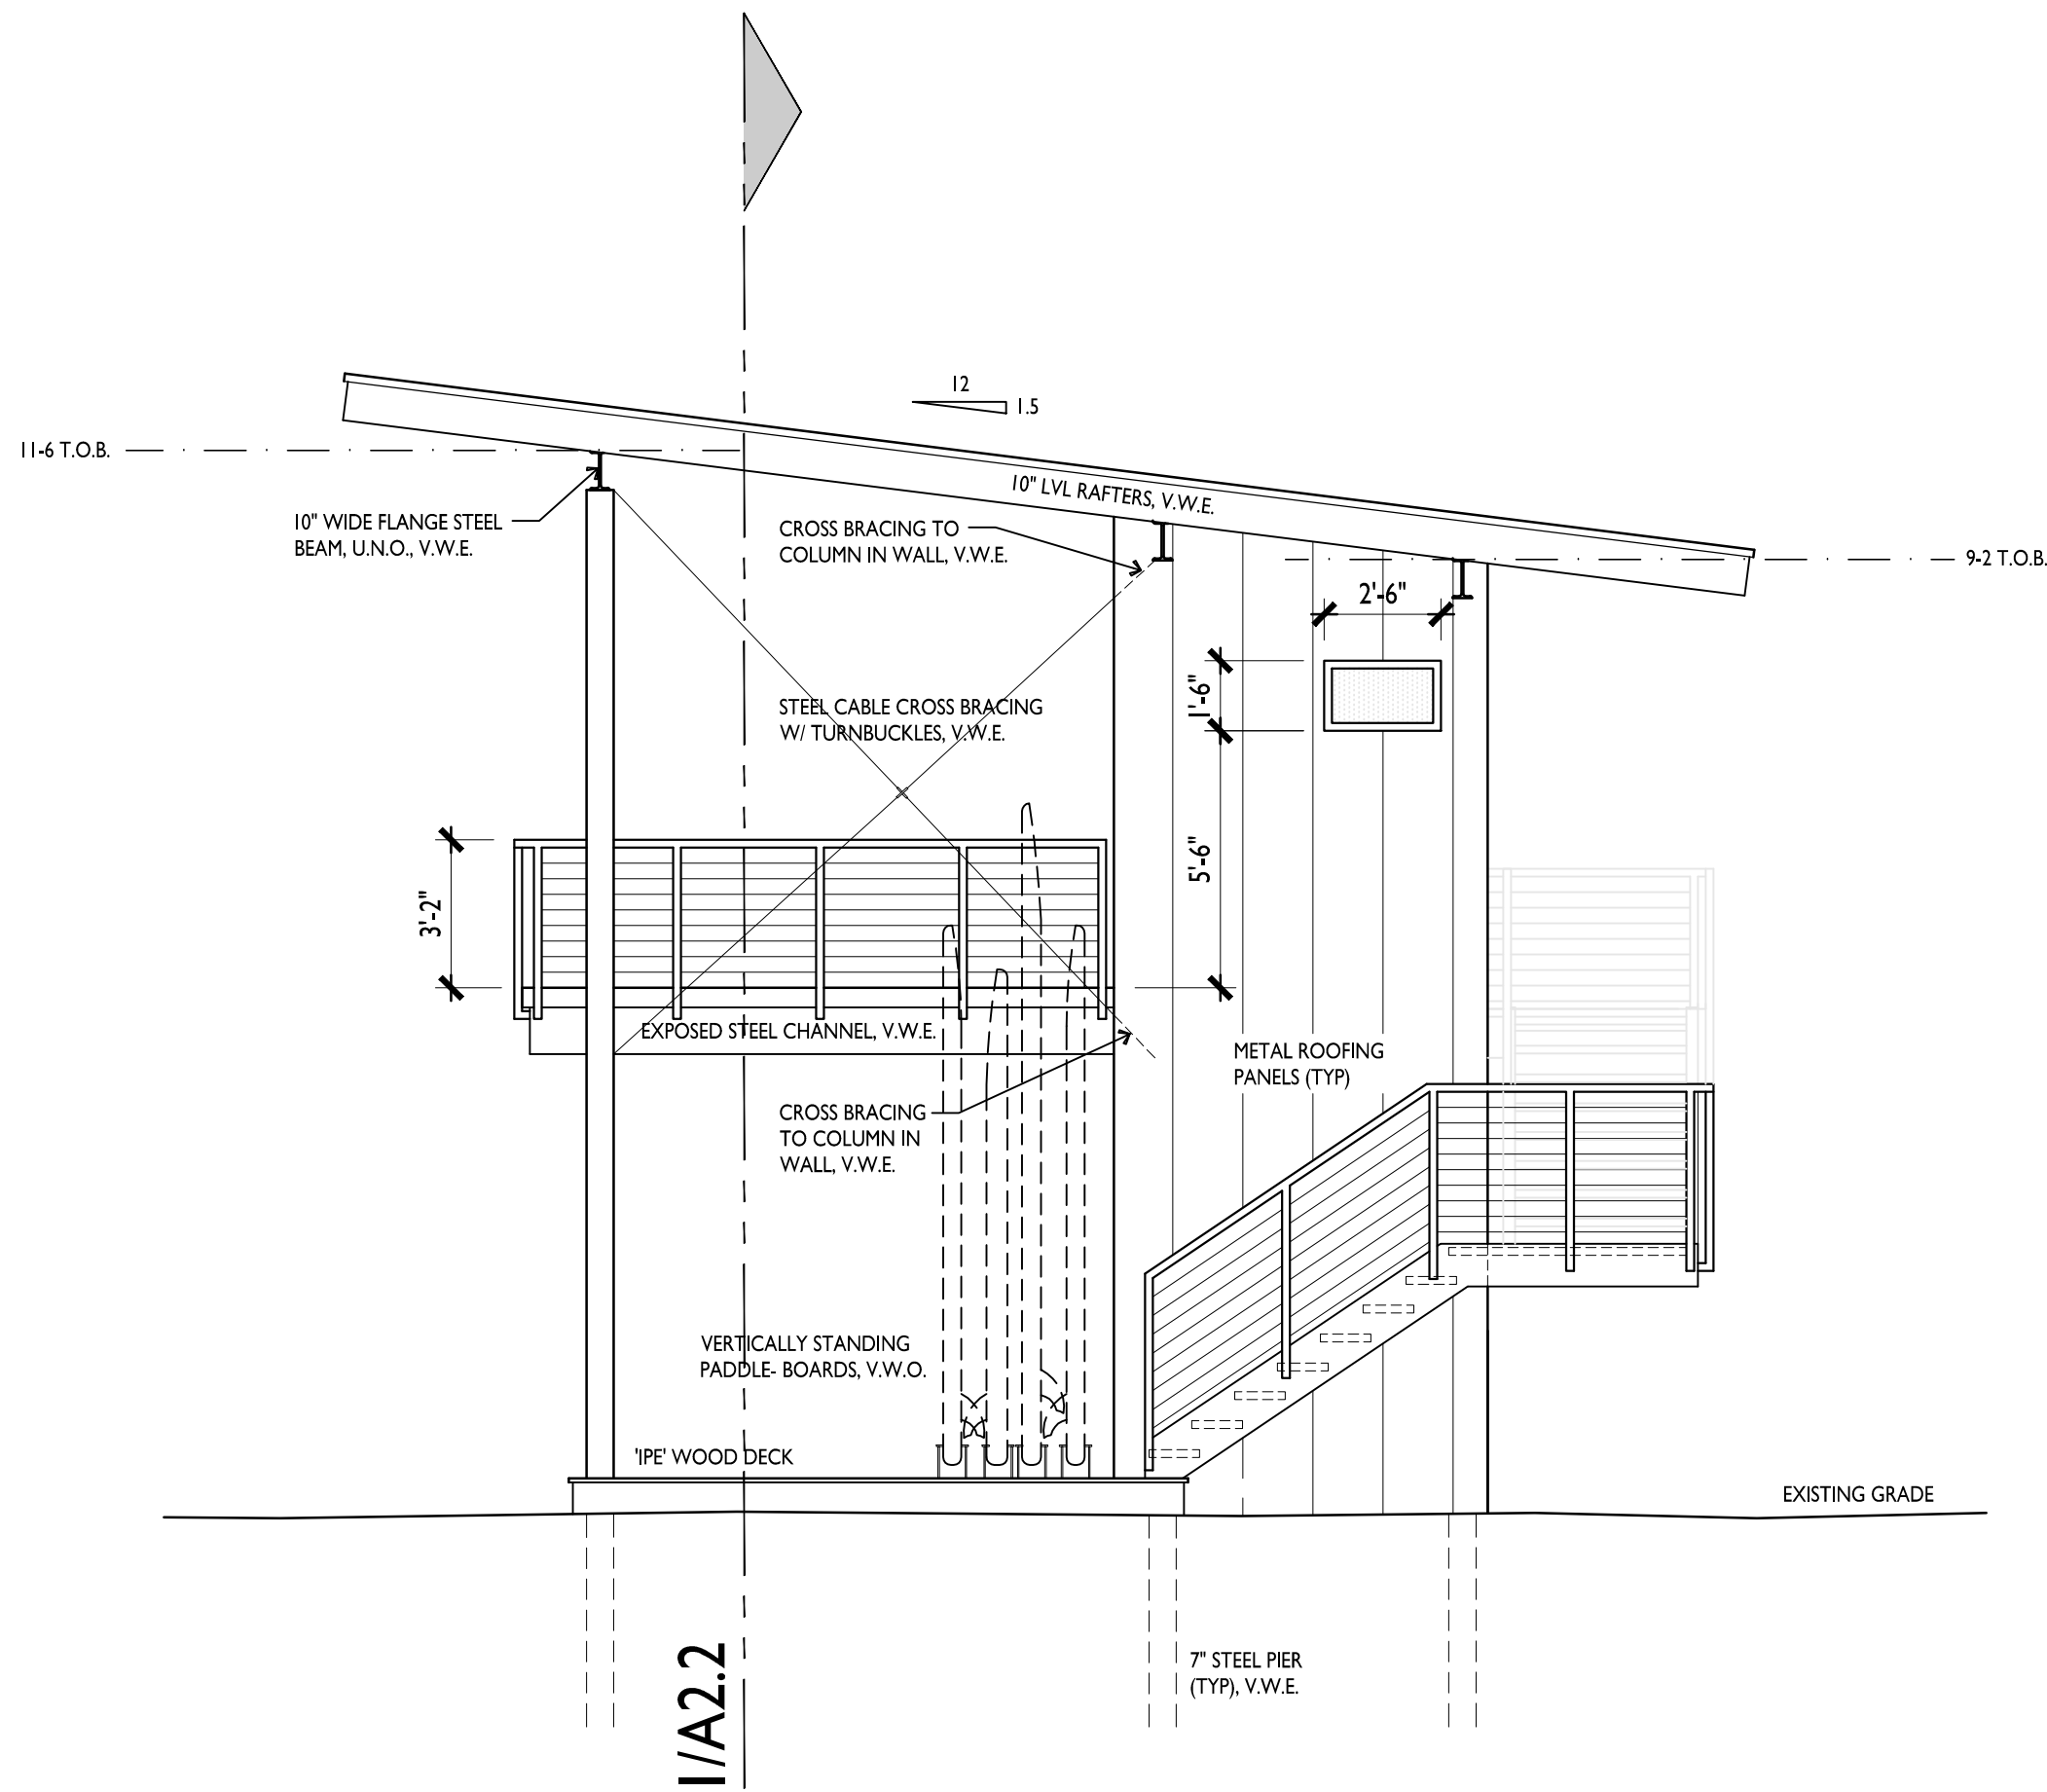


3. house side elevation

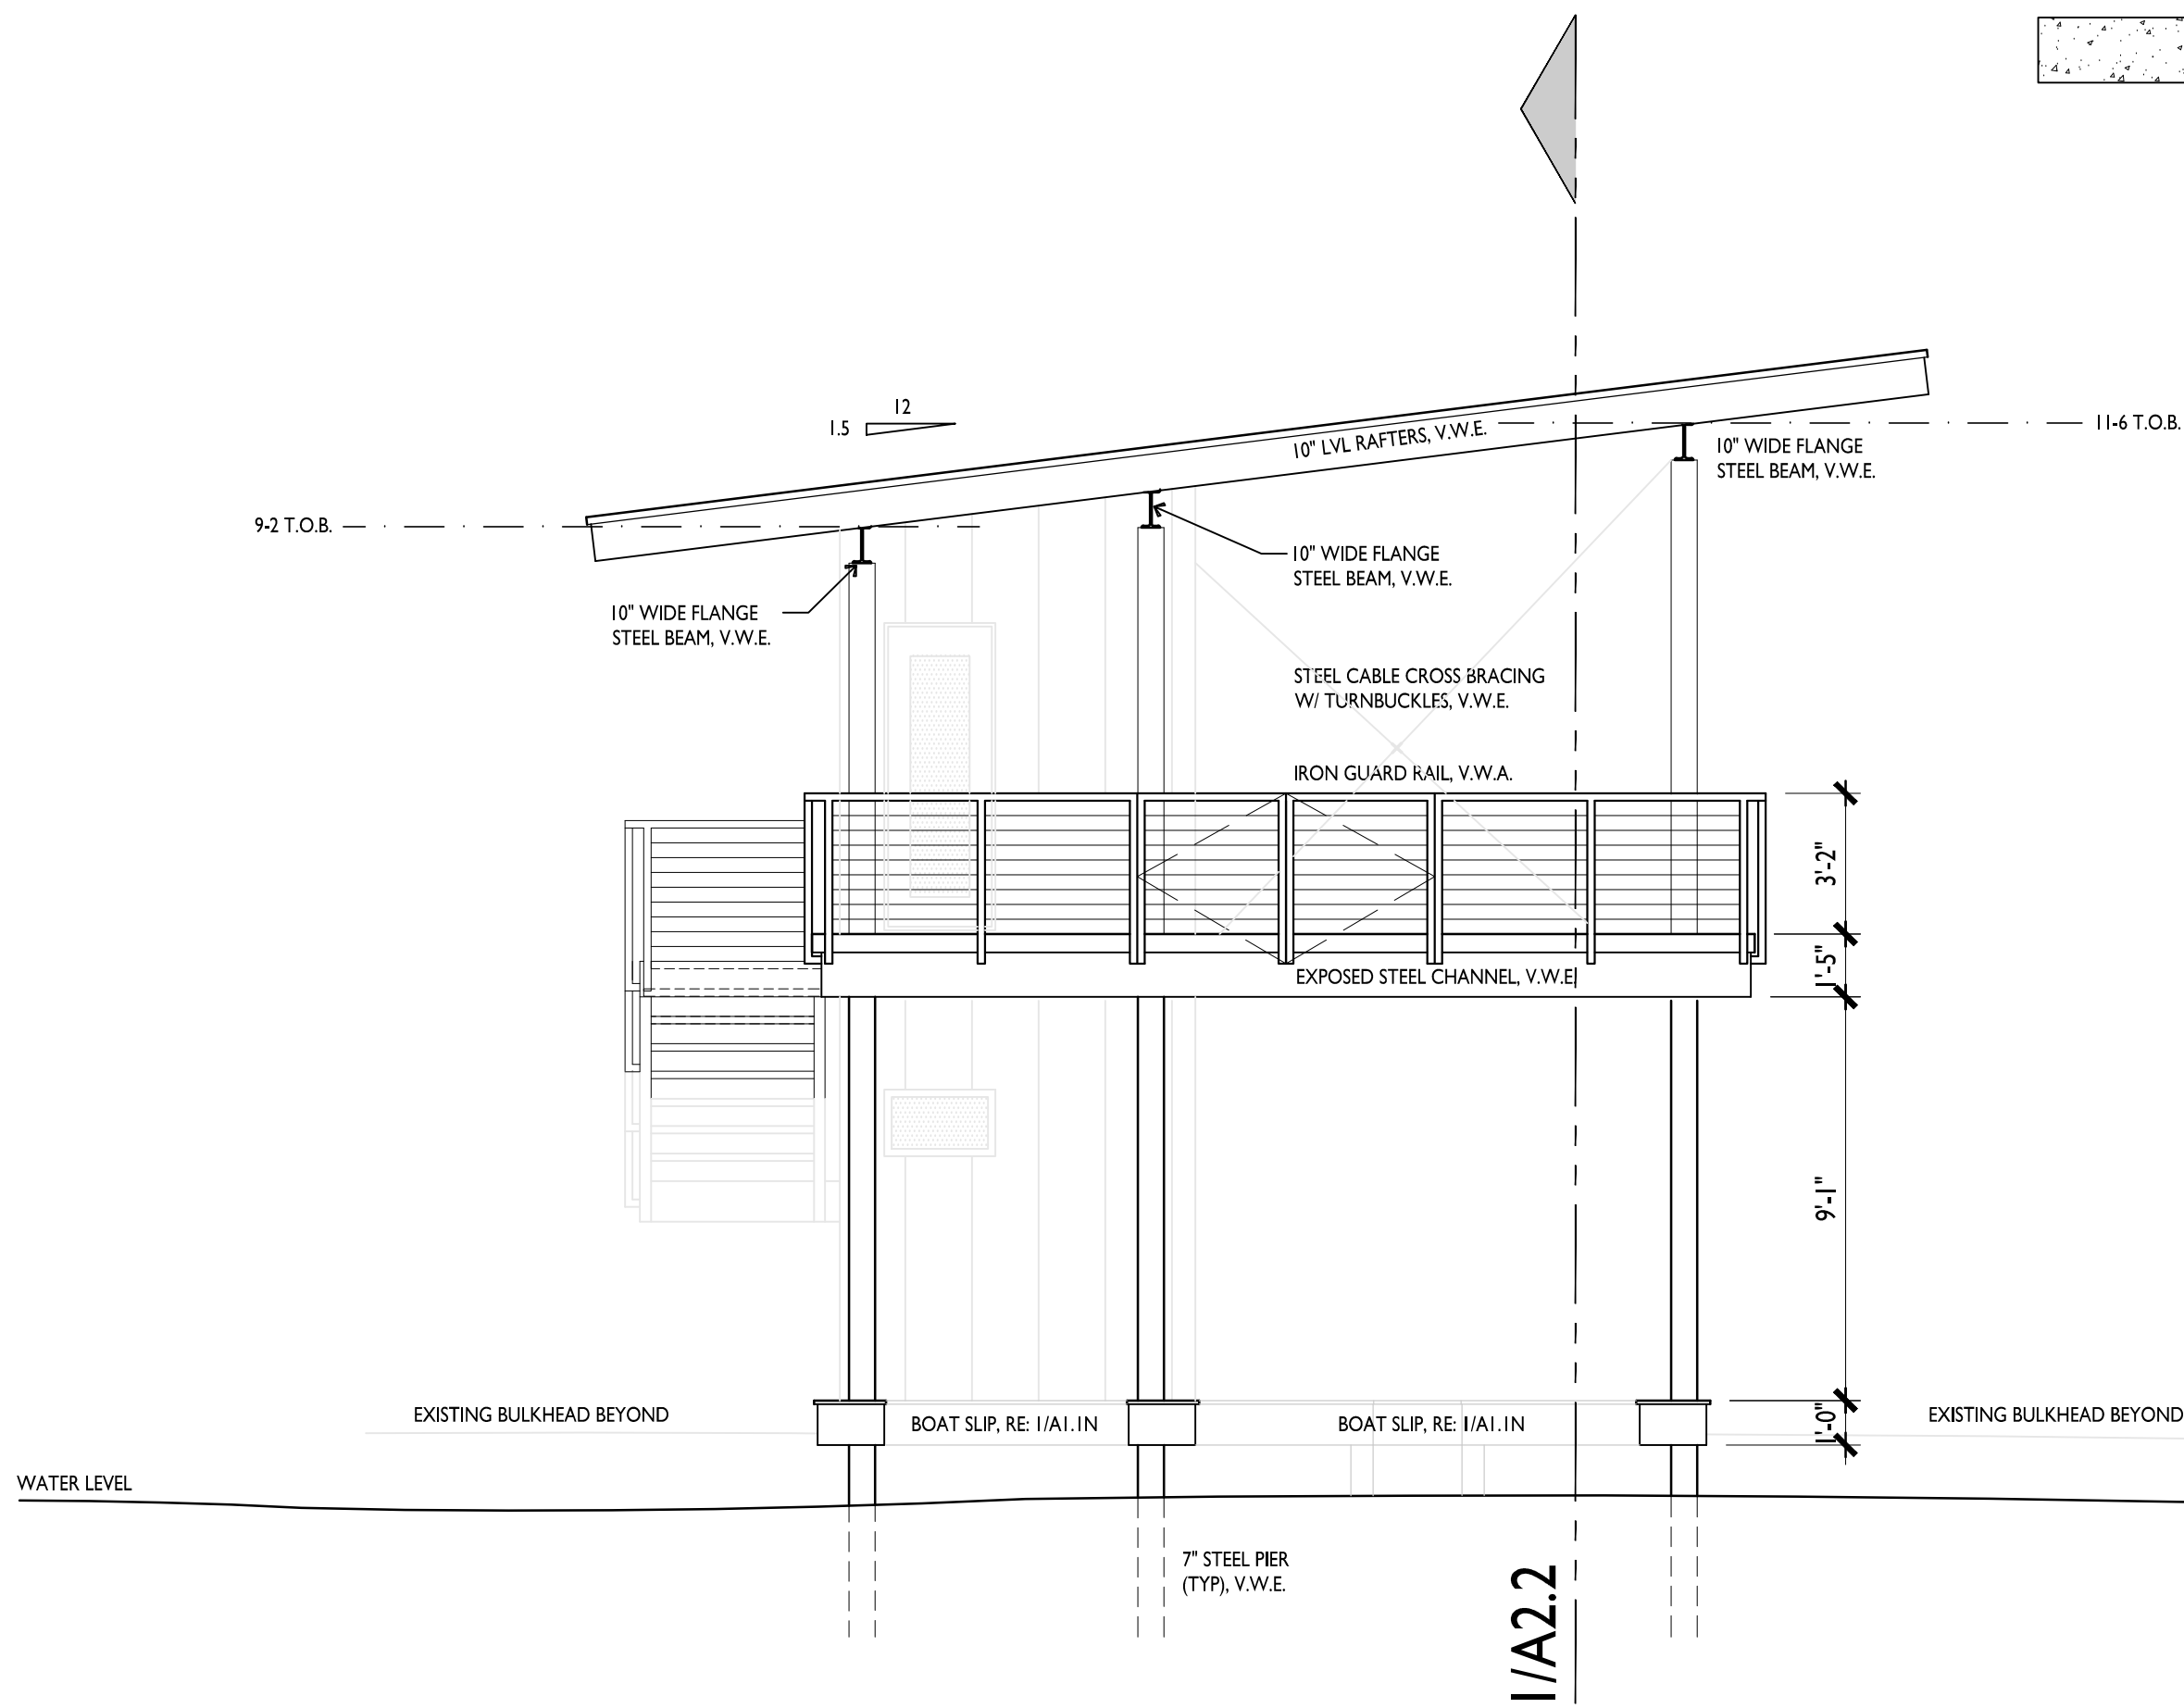

4. lake side elevation

I. GENERAL NOTES:

1. WINDOW SIZES: 3050 CSMT. = 3'-0" x 5'-0" CASEMENT WINDOW.
8'-0" HDR. = BOTTOM OF HEADER @ 8'-0"
2. EX. OPERABLE CASEMENT WINDOW OR AWNING WINDOW.

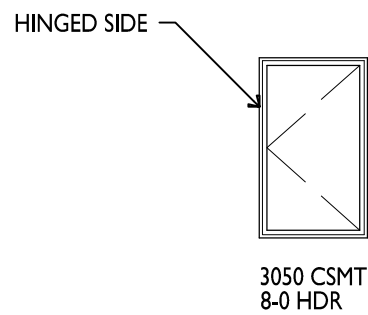

2. ABBREVIATIONS:

- MISC.
- | | |
|---|--------------------------------|
| A.F.F. - ABOVE FINISHED FLOOR | OPT - OPTIONAL |
| A.M.C. - ALUMINUM MULL COVER (BY WINDOW MANUFACTURER) | RND - ROUND |
| AWN. - AWNING | S.H. - SINGLE HUNG |
| COL - COLUMN | V.W.A. - VERIFY WITH ARCHITECT |
| CSMT. - CASEMENT | V.W.B. - VERIFY WITH BUILDER |
| D.H. - DOUBLE HUNG | V.W.O. - VERIFY WITH OWNER |
| D.S. - DOWNSPOUT | WDW. - WINDOW |
| FXD. - FIXED | WD. - WOOD |
| HDR. - HEADER | |
| HDWD. - HARDWOOD | |
| MAS - MASONRY | |
| MFCTR. - MANUFACTURER | |
| MTL - METAL | |

3. LEGEND

- | | |
|-----------|-------------------------|
| --- | PLATE |
| --- | HEADER (HDR.) |
| --- | FINISHED FLOOR |
| --- | BRICK LINE |
| --- | EXISTING GRADE (GROUND) |
| --- | FINISHED GRADE (GROUND) |
| [Pattern] | MASONRY VENEER |
| [Pattern] | STUCCO VENEER |
| [Pattern] | METAL ROOF OR SIDING |
| [Pattern] | CONCRETE |

exterior elevations 1/4" = 1'-0"

Copyright © 2012, James D. LaRue Architecture Design, Inc.
Drawn By:

JAMES D. LARUE
ARCHITECT, TX#12667
THESE DOCUMENTS ARE
INCOMPLETE AND MAY
NOT BE USED FOR
REGULATORY APPROVAL,
PERMIT OR CONSTRUCTION

james d. larue architects
500 n. capital of tx hwy.
big d. ste building 70746
512.347.1688
www.larue-architects.com

LARUE
a r c h i t e c t s



THE SMITH DOCK
1504 rockcliff rd, austin,tx

AUG. 7, 2012

ELEVATIONS

A2.1

□


$$1/4" = 1' - 0"$$


SECOND FLOOR STORAGE	51
TOTAL COVERED	1,133

AI.IN