

RULE NO.: R161-21.07

NOTICE OF RULE ADOPTION

ADOPTION DATE: February 22, 2021

By: Greg Meszaros, Director
Austin Water

The Director of the Department of Austin Water has adopted the following rule. Notice of the proposed rule was posted on January 14, 2021. Public comment on the proposed rule was solicited in the January 14, 2021 notice. This notice is issued under Chapter 1-2 of the City Code. The adoption of a rule may be appealed to the City Manager in accordance with Section 1-2-10 of the City Code as explained below.

This Notice of Rule Adoption was posted on the City website by the City Clerk. Date and time stamp are on the front of the notice.

EFFECTIVE DATE OF ADOPTED RULE

A rule adopted by this notice is effective on February 22, 2021.

TEXT OF ADOPTED RULE

The adopted rule contains no changes from the proposed rule.

R161-21.07: Proposed revision to the Standard 501-AW-01

Rule 2 – Standard 501-AW-01

- Standard 501-AW-01 – This detail will replace the existing 501S-1 Standard. It is being altered to correct incorrect callouts.

The adopted rule contains no changes from the proposed rule. This Notice of Rule Adoption was posted on the City website by the City Clerk. Date and time stamp is on the front of the notice.

SUMMARY OF COMMENTS

Austin Water did not receive comments regarding the rule adopted in this notice.

AUTHORITY FOR ADOPTION OF RULE

The authority and procedure for adoption of a rule to assist in the implementation, administration, or enforcement of a provision of the City Code is provided in Chapter 1-2 of the City Code. The authority to regulate the installation of water and wastewater facilities is established in the Texas Local Government Code Section 552.001 and Title 15 of the City Code.

APPEAL OF ADOPTED RULE TO CITY MANAGER

A person may appeal the adoption of a rule to the City Manager. **AN APPEAL MUST BE FILED WITH THE CITY CLERK NOT LATER THAN THE 30TH DAY AFTER THE DATE THIS NOTICE OF RULE ADOPTION IS POSTED. THE POSTING DATE IS NOTED ON THE FIRST PAGE OF THIS NOTICE.** If the 30th day is a Saturday, Sunday, or official city holiday, an appeal may be filed on the next day which is not a Saturday, Sunday, or official city holiday.

An adopted rule may be appealed by filing a written statement with the City Clerk. A person who appeals a rule must (1) provide the person's name, mailing address, and telephone number; (2) identify the rule being appealed; and (3) include a statement of specific reasons why the rule should be modified or withdrawn.


Notice that an appeal was filed and will be posted by the city clerk. A copy of the appeal will be provided to the City Council. An adopted rule will not be enforced pending the City Manager's decision. The City Manager may affirm, modify, or withdraw an adopted rule. If the City Manager does not act on an appeal on or before the 60th day after the date the notice of rule adoption is posted, the rule is withdrawn. Notice of the City Manager's decision on an appeal will be posted by the city clerk and provided to the City Council.

On or before the 16th day after the city clerk posts notice of the City Manager's decision, the City Manager may reconsider the decision on an appeal. Not later than the 31st day after giving written notice of an intent to reconsider, the City manager shall make a decision.

CERTIFICATION BY CITY ATTORNEY

By signing this Notice of Rule Adoption R161-21.07, the City Attorney certifies that the City Attorney has reviewed the rule and finds that adoption of the rule is a valid exercise of the Director's administrative authority.

REVIEWED AND APPROVED



Greg Meszaros, Director
Austin Water


Date: 02/09/2021

Anne L Morgan


Anne L. Morgan
City Attorney

Date: 2/11/2021

FIELD WELDS IN ENCASEMENT PIPE
SHALL BE FULL CIRCUMFERENCE
BUTTWELD PER AWWA C206.

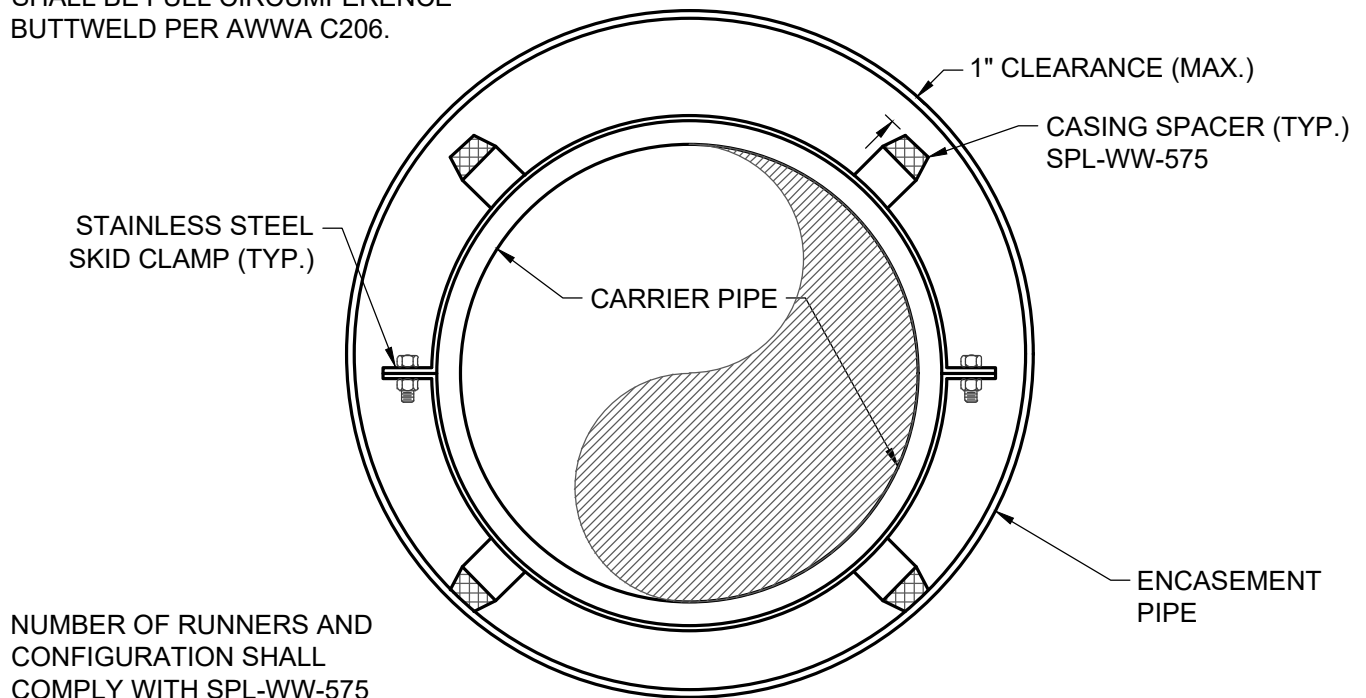


NUMBER OF RUNNERS AND
CONFIGURATION SHALL
COMPLY WITH SPL-WW-575

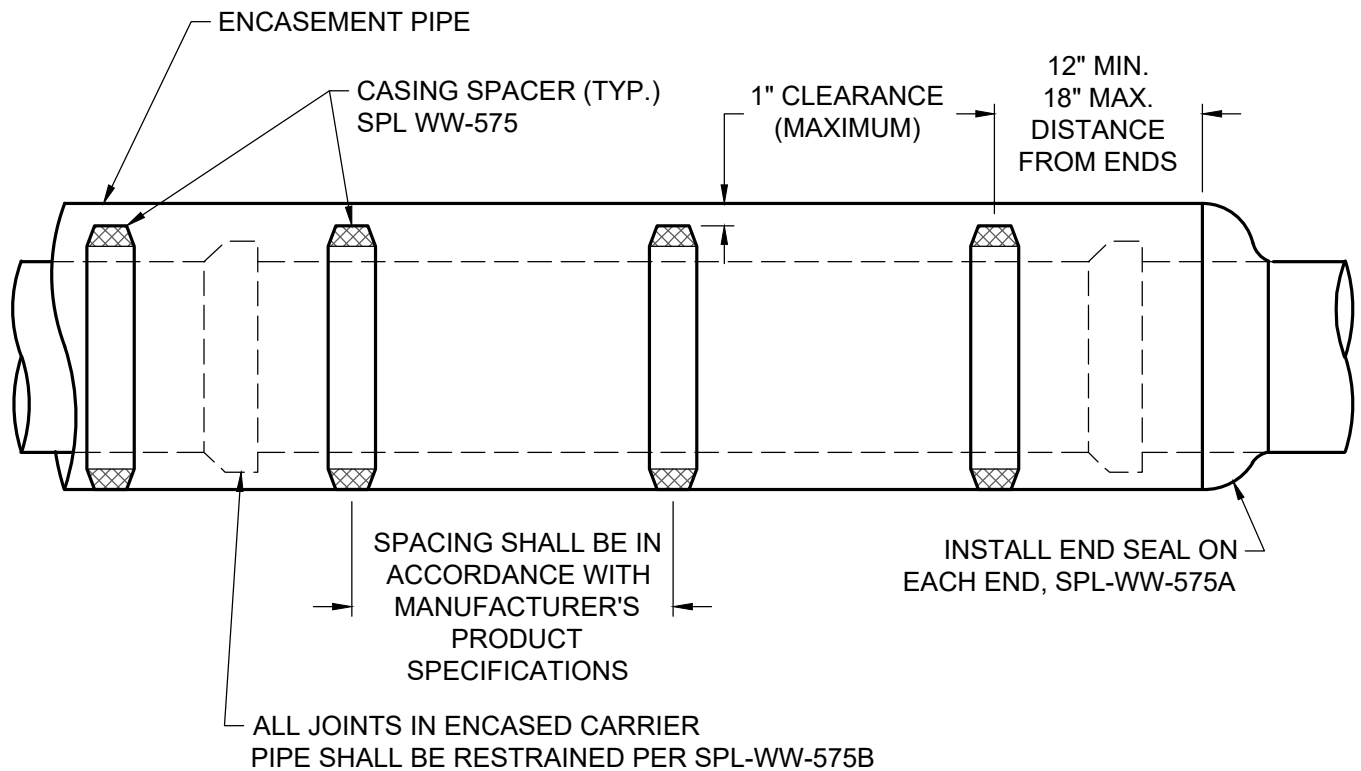


APPLICABLE REFERENCES:
STANDARD SPECIFICATION: ITEM 505.4 & 510.3 (19)

CITY OF AUSTIN AUSTIN WATER		ENCASEMENT PIPE DETAIL WITH CASING SPACERS	
JEFF A. KYLE	02/22/2021 ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. 501-AW-01 1 OF 1

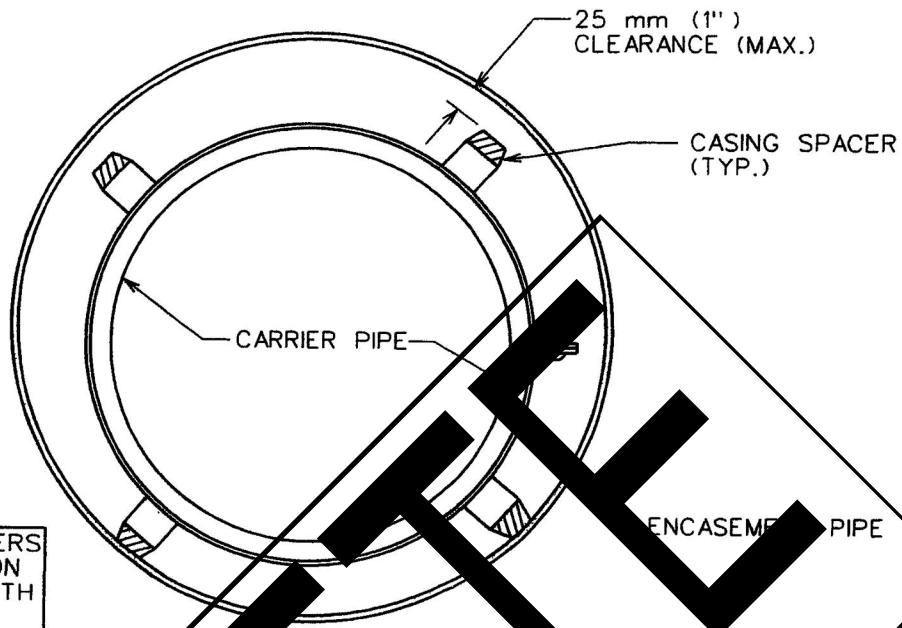

NUMBER OF RUNNERS
AND CONFIGURATION
SHALL COMPLY WITH
MANUFACTURERS
APPROVED SHOP
SUBMITTAL.

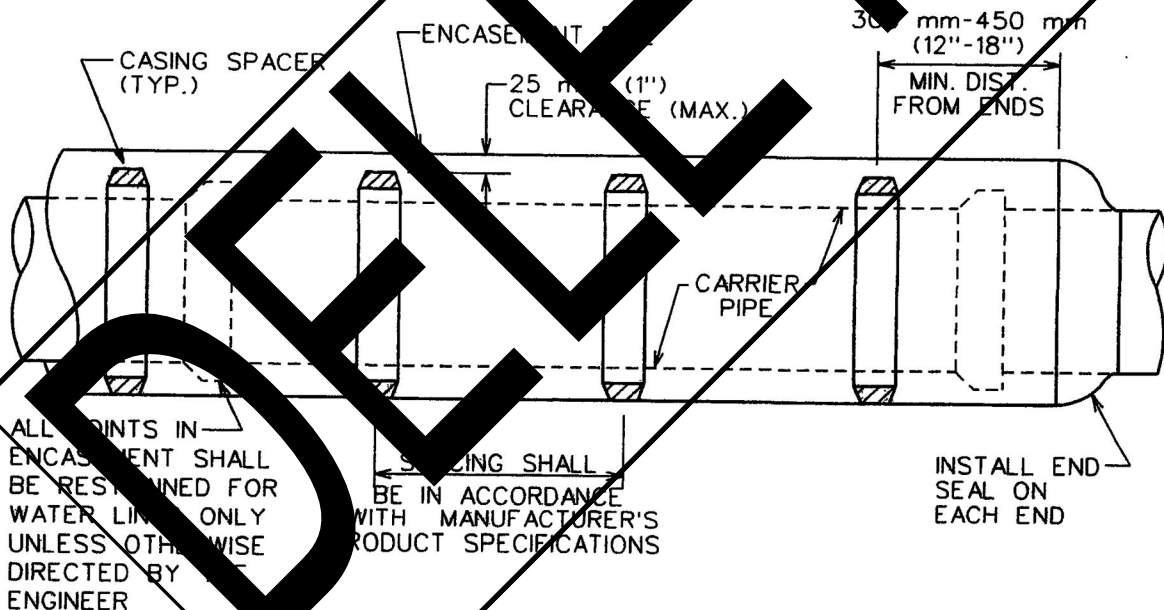

ALL JOINTS IN
ENCASEMENT SHALL
BE RESTRAINED FOR
WATER LEAK ONLY
UNLESS OTHERWISE
DIRECTED BY THE
ENGINEER

APPLICABLE REFERENCES

STANDARD SPECIFICATION: ITEM 510S.3 (19) W/WW STANDARD PRODUCTS LIST: SPLWW-575
FOR CASING SPACER AND SPLWW-575A FOR END SEAL.

CITY OF AUSTIN
AUSTIN WATER UTILITY

ENCASEMENT DETAIL W/
CASING SPACERS

Kathi R. Flores 2/21/14

ADOPTED

THE ARCHITECT/ENGINEER ASSUMES
RESPONSIBILITY FOR APPROPRIATE USE
OF THIS STANDARD.

STANDARD NO.
501S-1