




A FULL RESIDENTIAL SPRINKLER SYSTEM
DESIGNED, INSTALLED AND TESTED IN
ACCORDANCE WITH THE NFPA 13D OR THE 2015
IRC P2904 STANDARDS WILL BE INSTALLED IN THIS
PROPERTY. THE PLANS FOR THE SPRINKLER
SYSTEM MUST BE DESIGNED AND INSTALLED BY A
TEXAS LICENSED SPRINKLER CONTRACTOR FOR
NFPA 13D SYSTEMS OR A TEXAS LICENSED
PLUMBER WITH THE IRC P2904 ENDORSEMENT ON
THEIR LICENSE. THE SPRINKLER PLANS MUST BE
SUBMITTED, REVIEWED, APPROVED, TESTED AND
INSPECTED BY AFD PRIOR TO COVERING THE
WALLS AND CEILINGS.

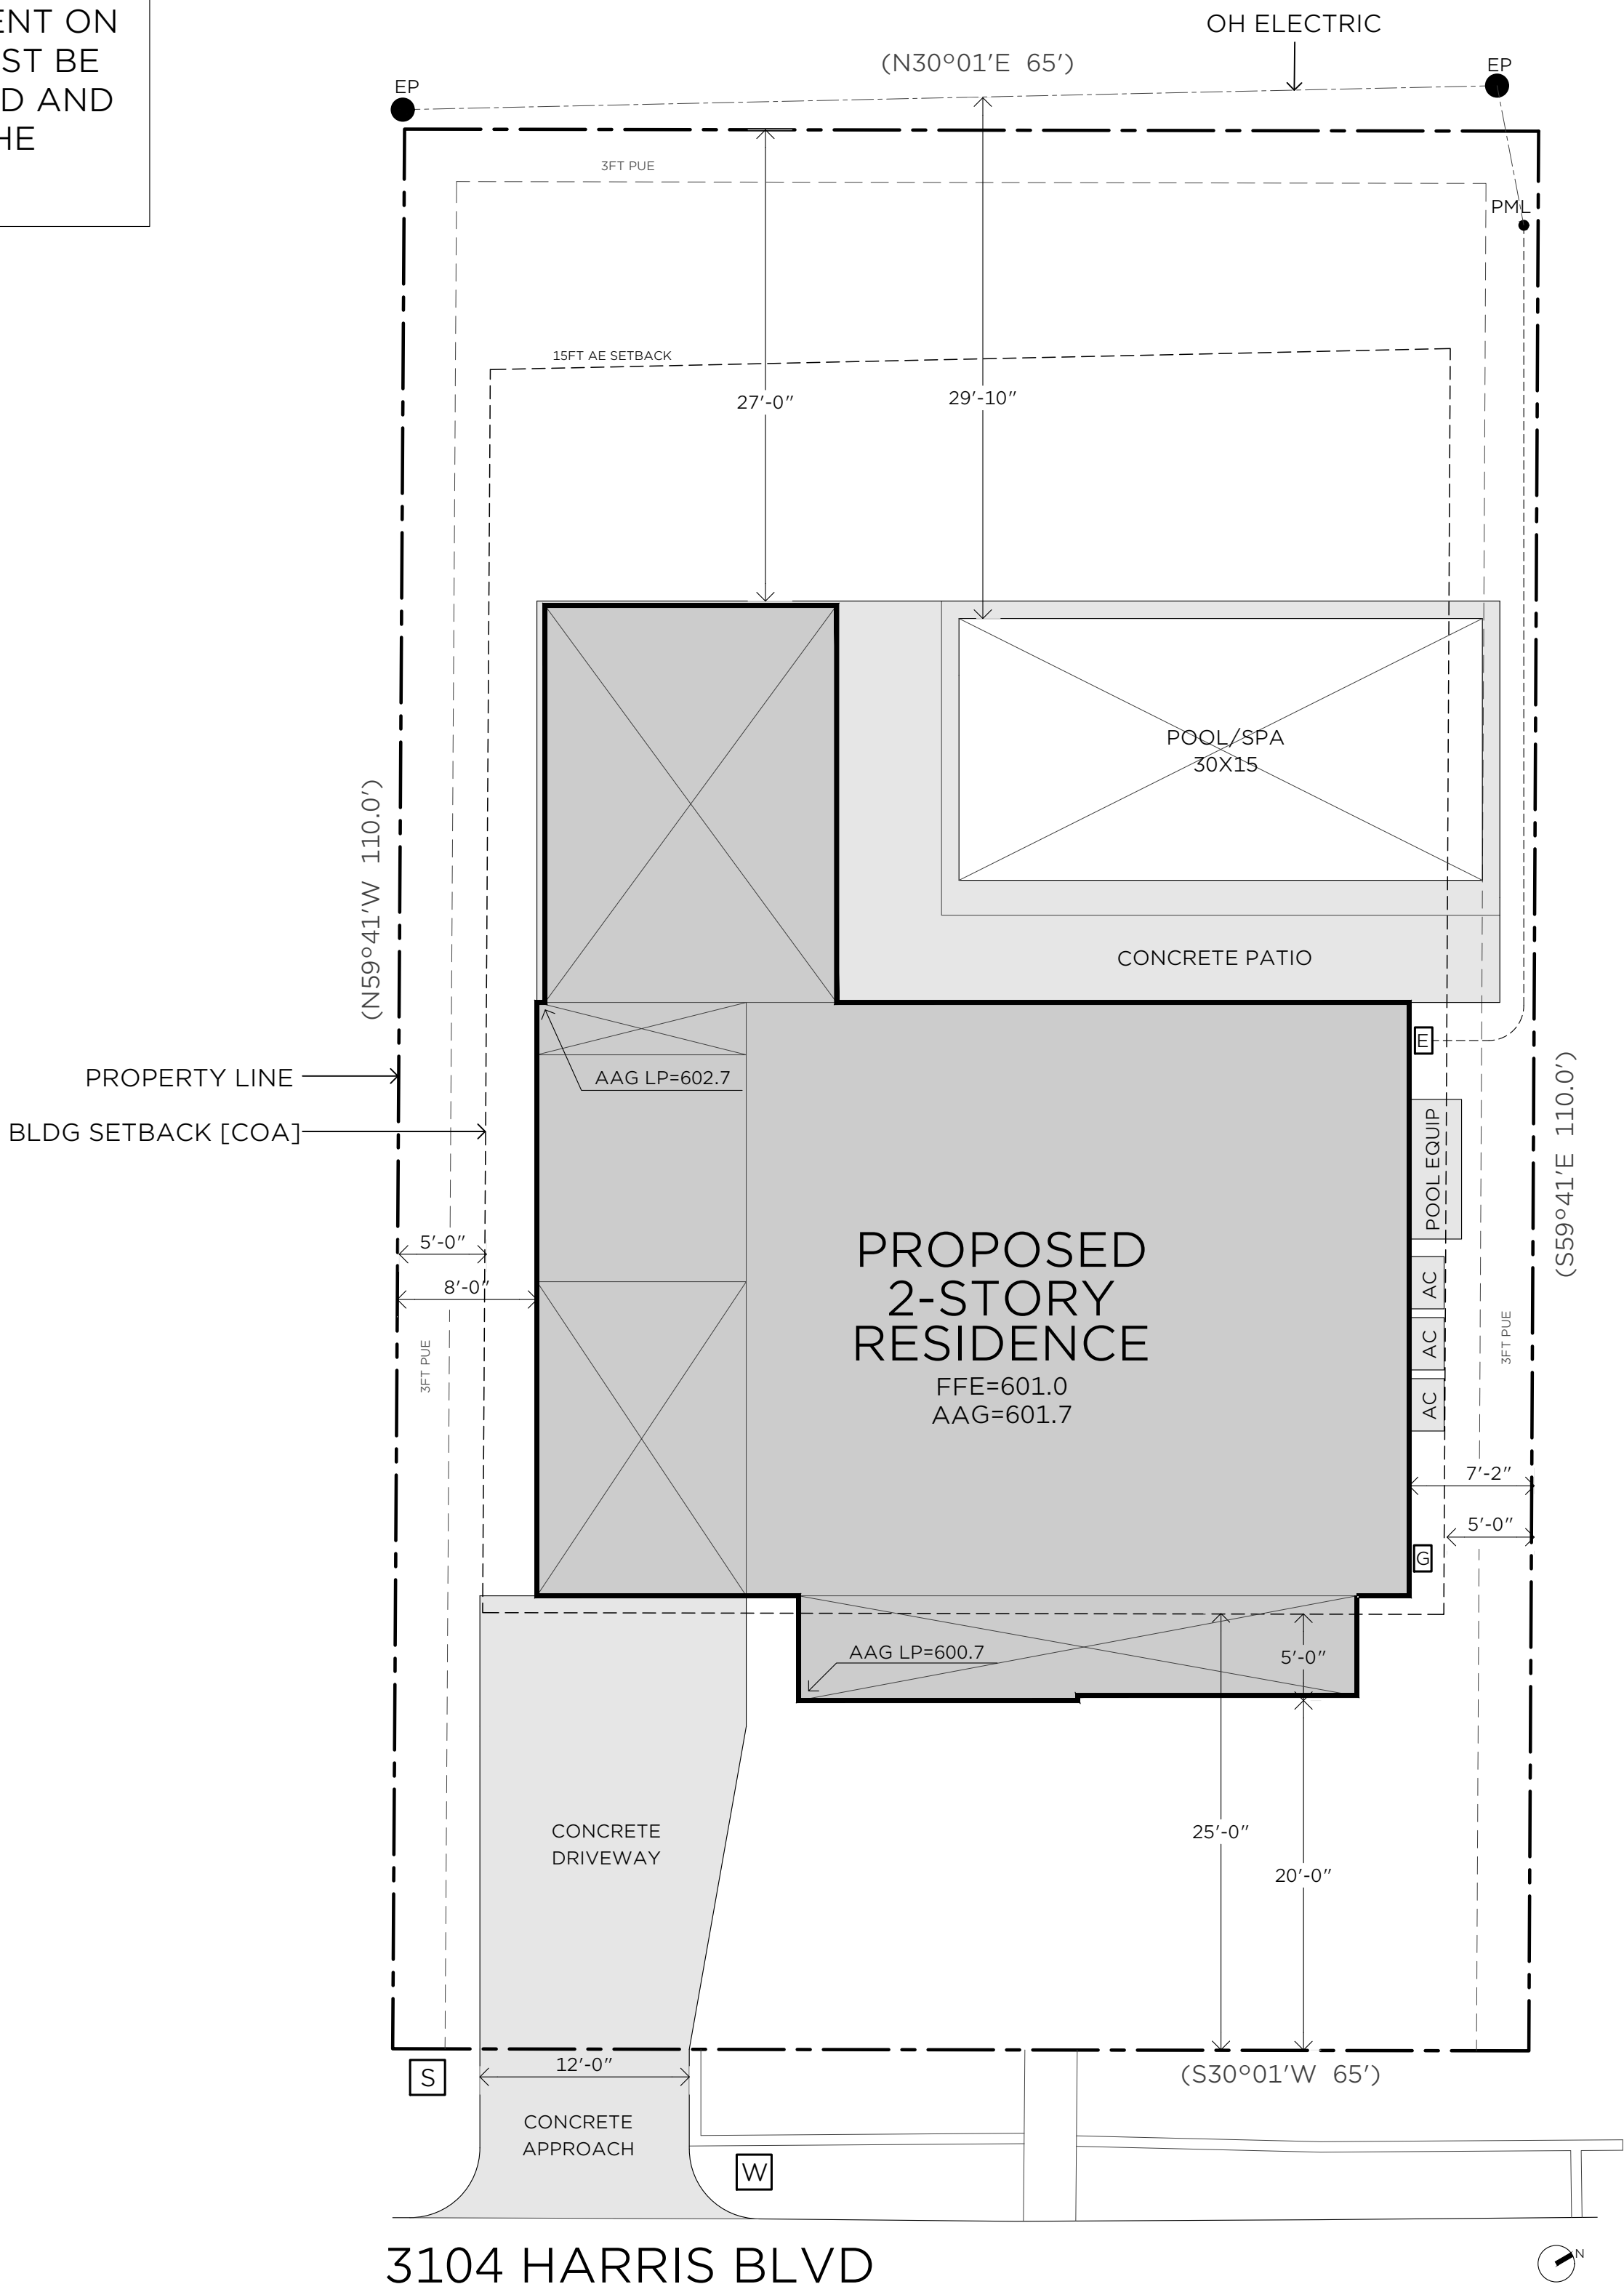


SITEPLAN

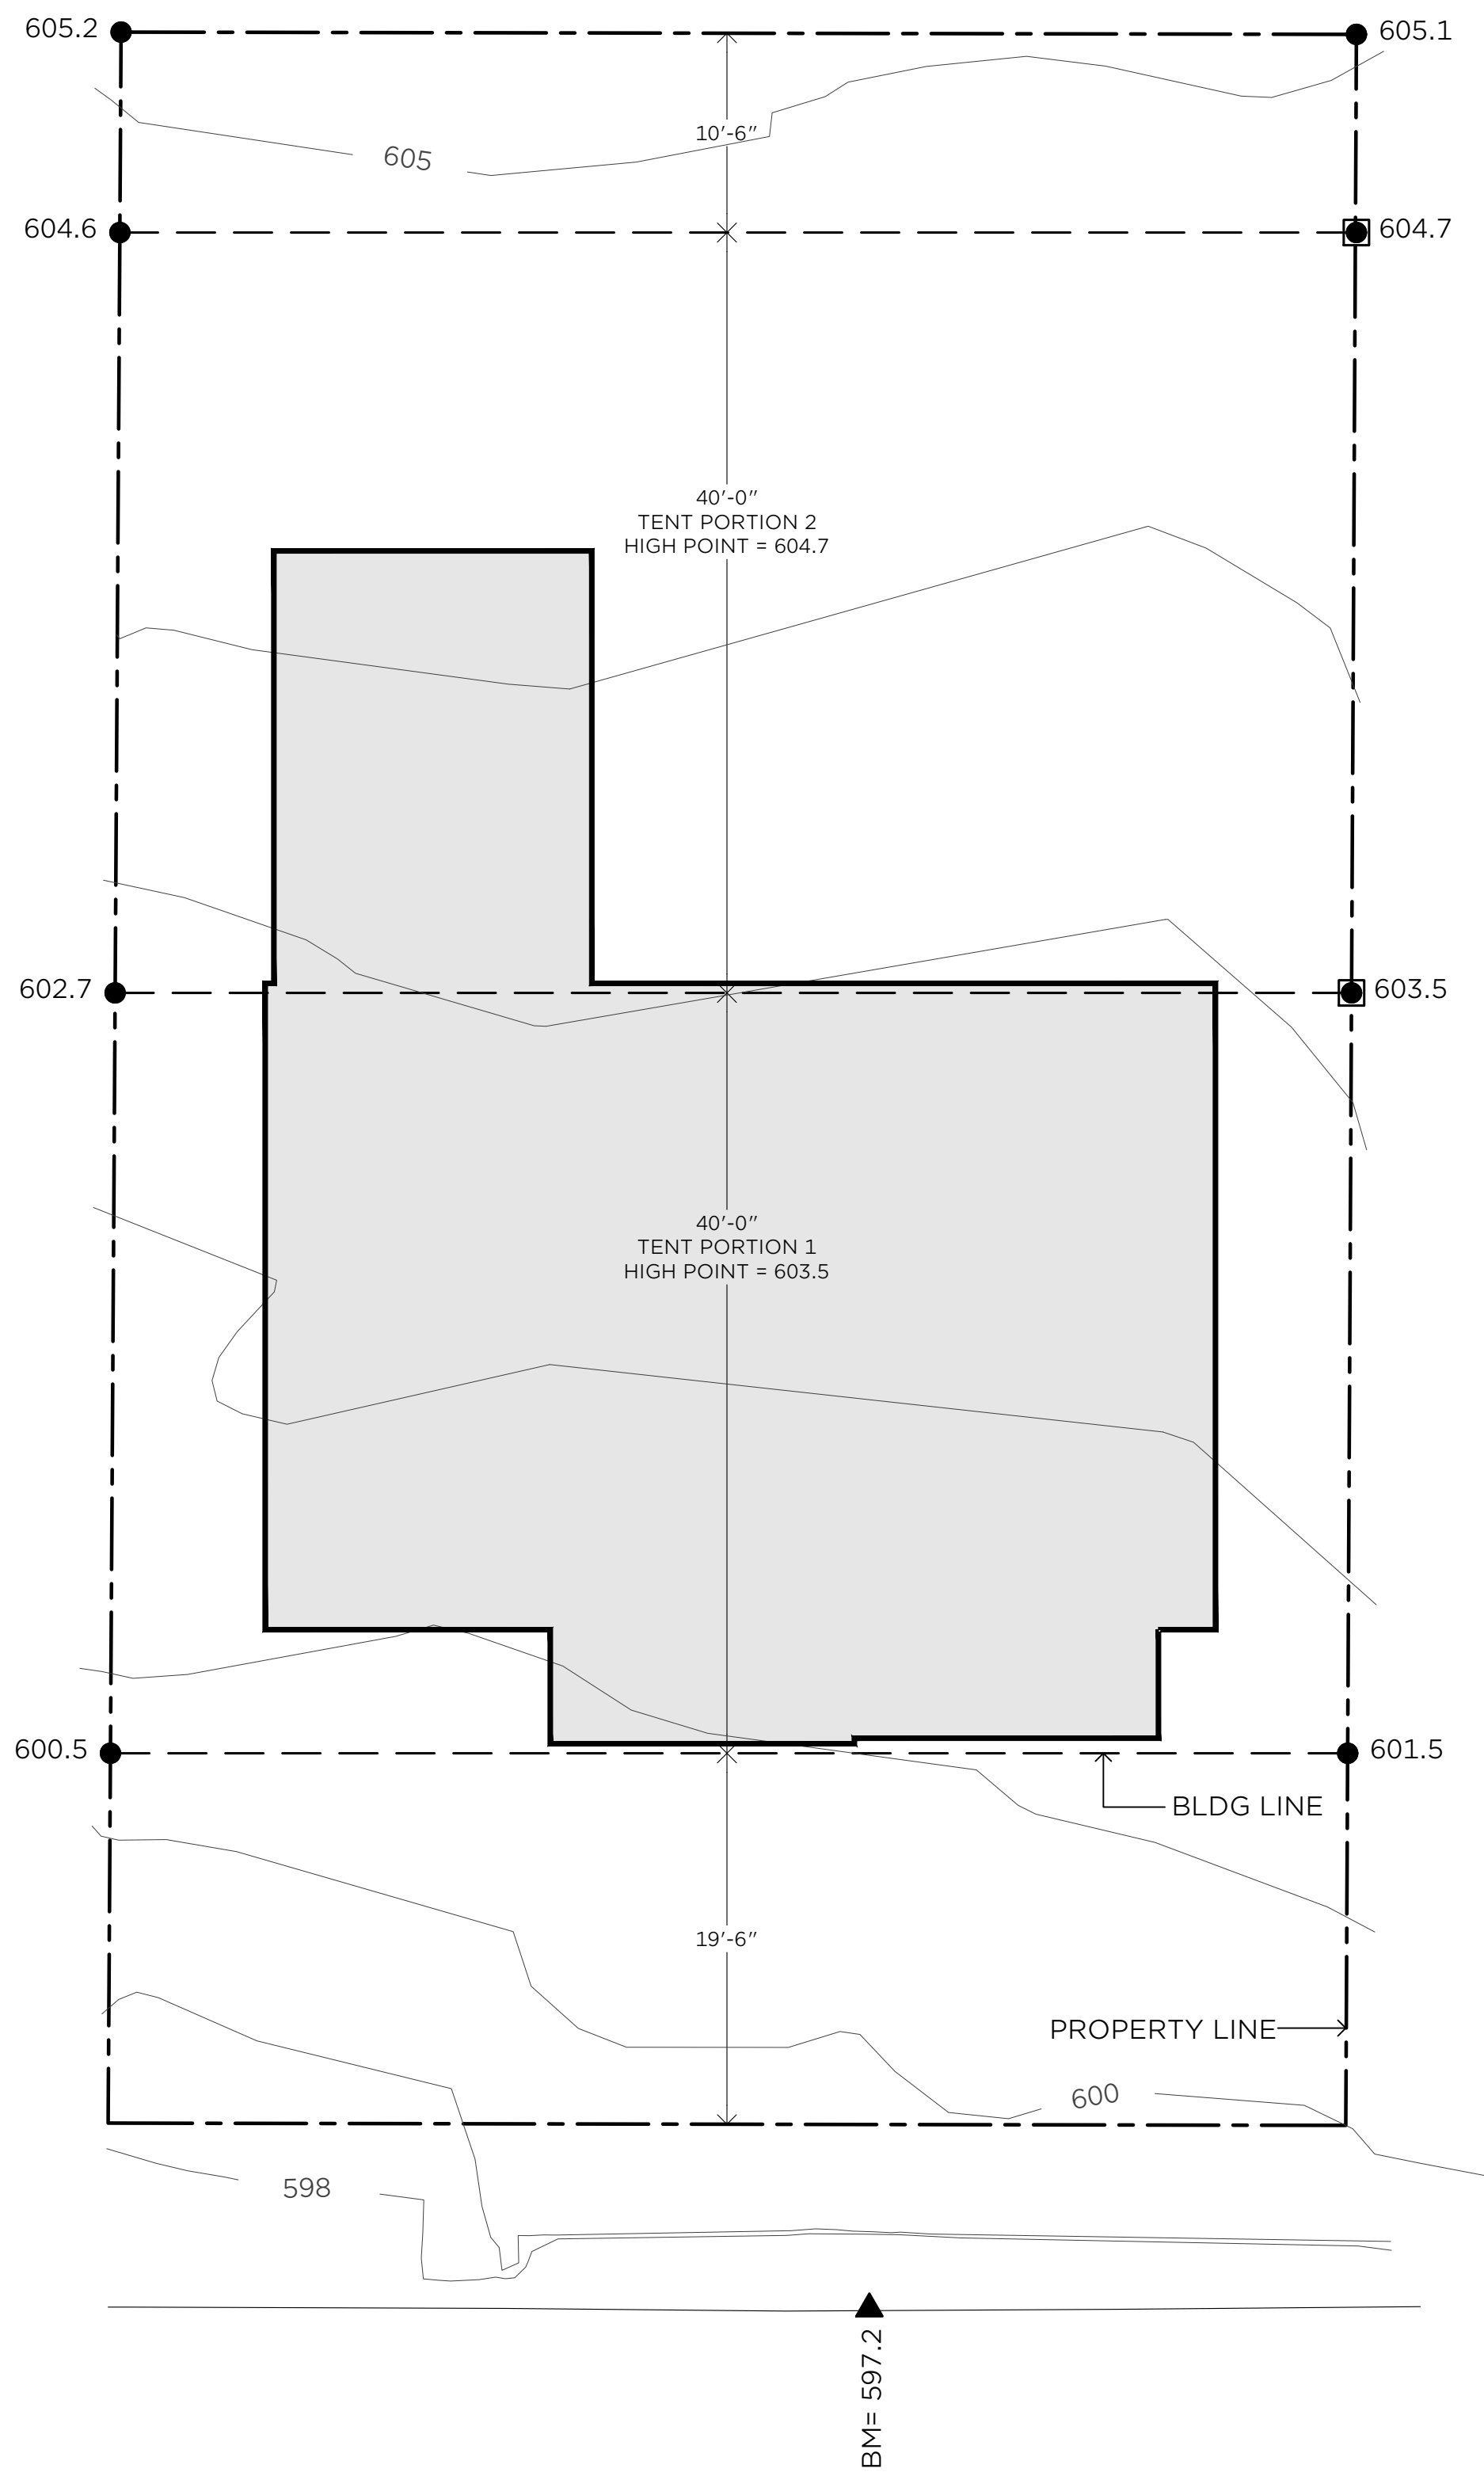

SETBACK PLANE COMPLIANCE EXHIBIT

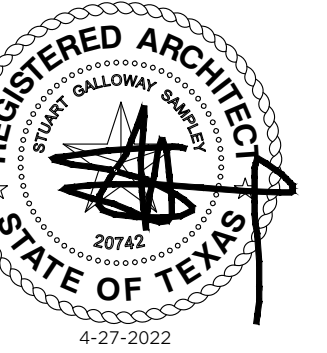


3104 HARRIS BLVD

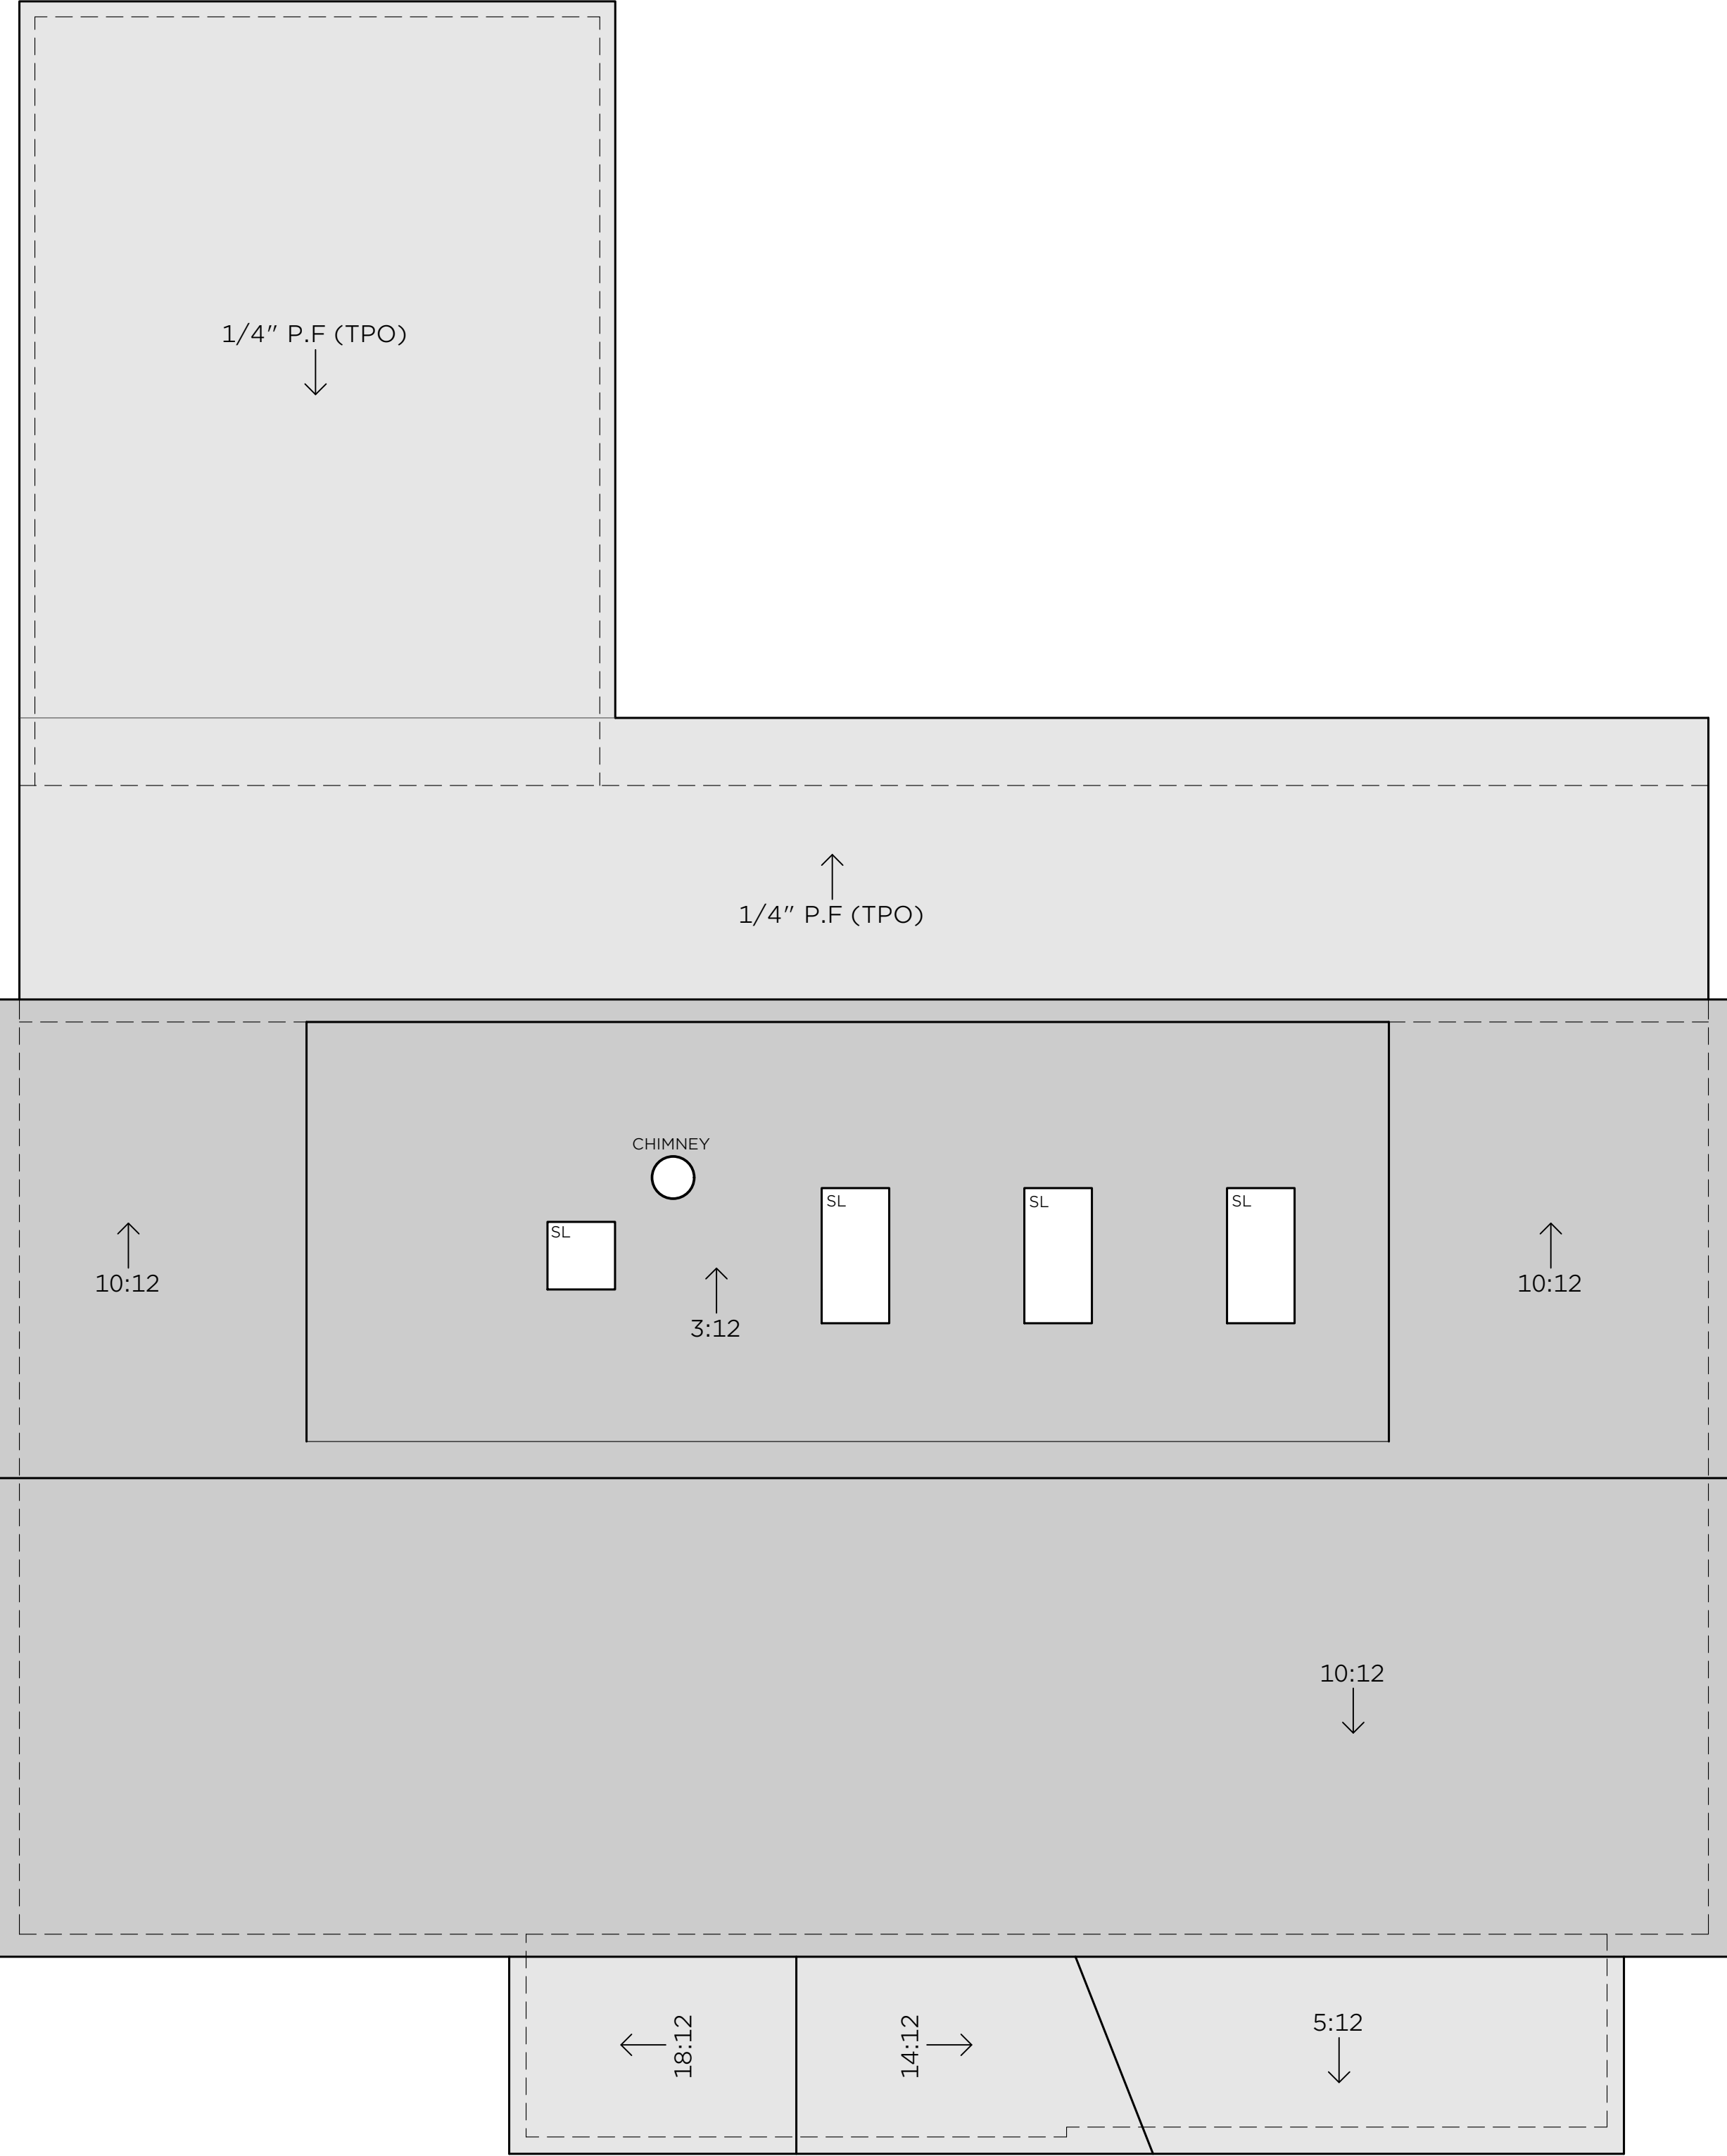


1 ROOF PLAN



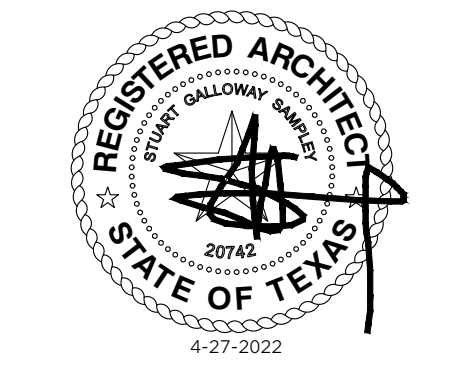


3104 HARRIS BLVD

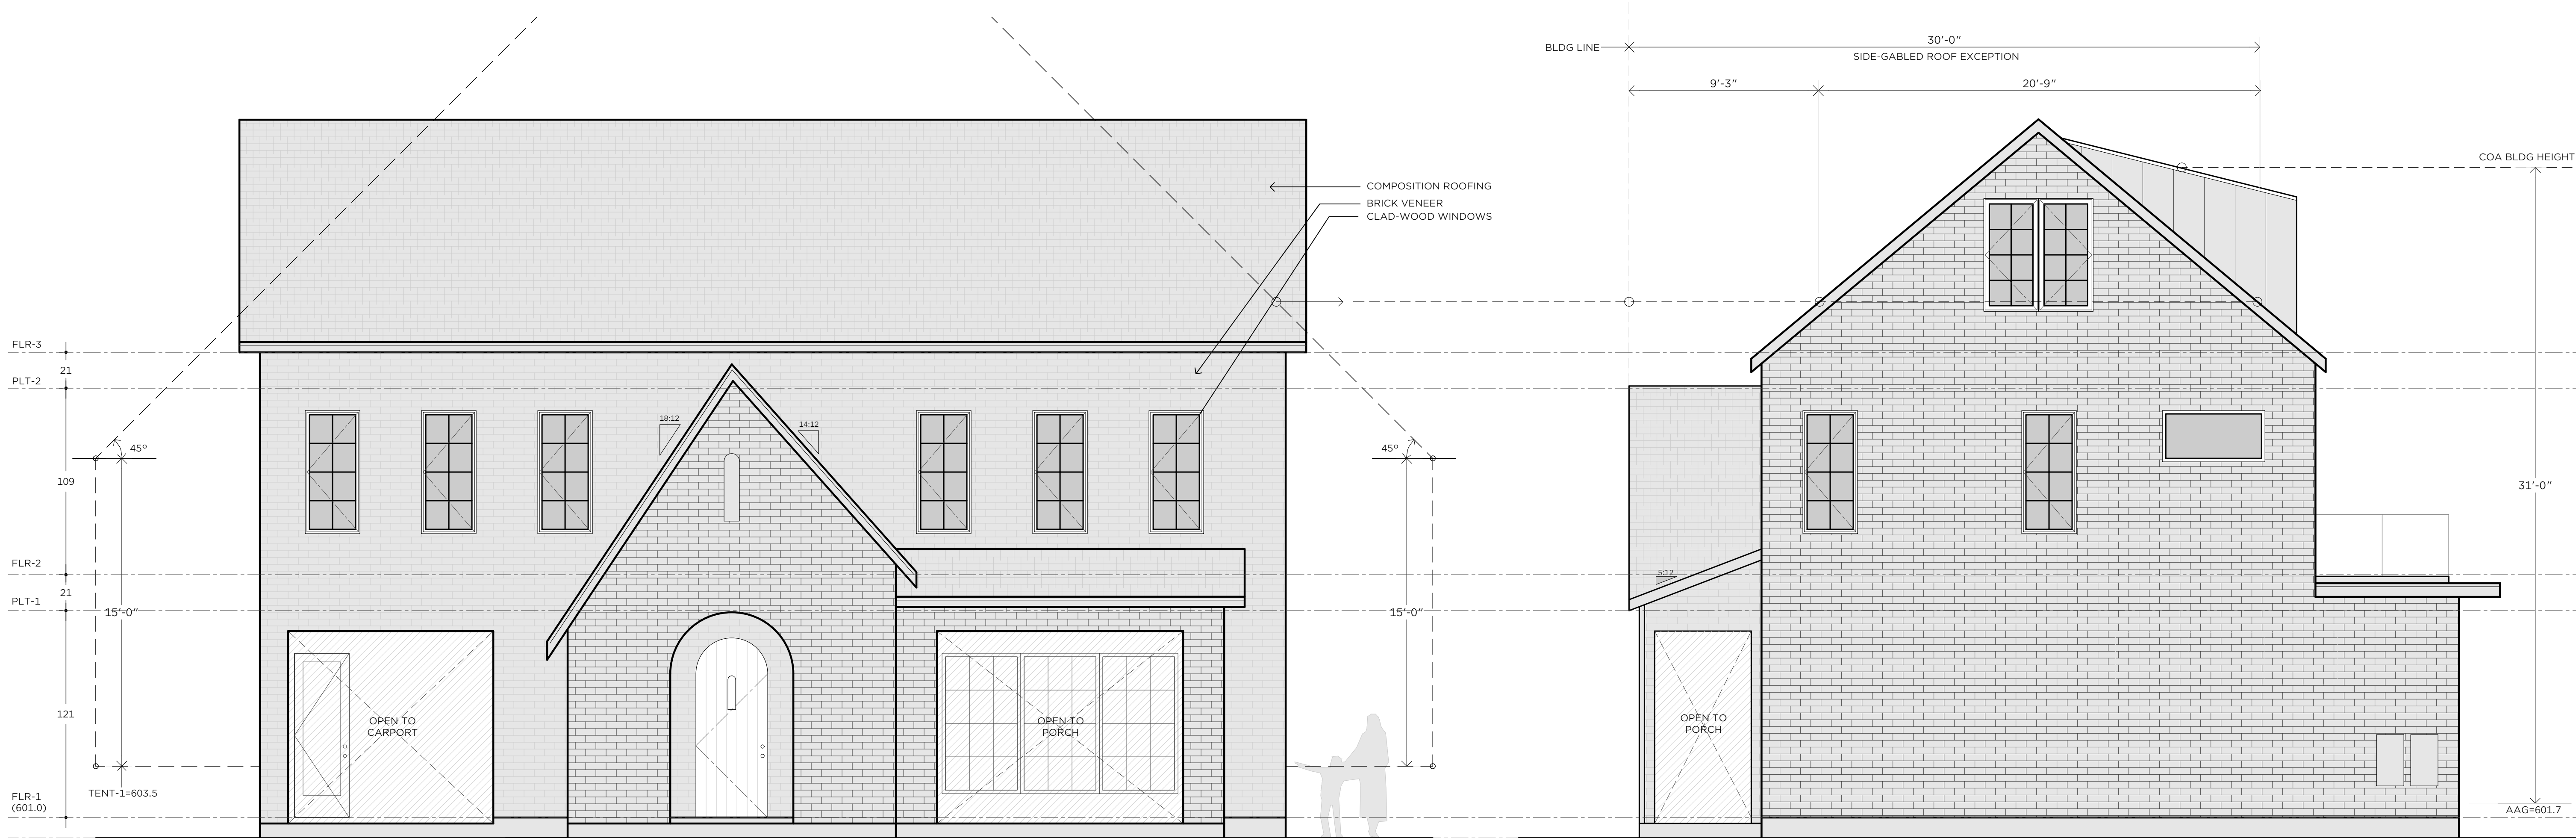

1 FRONT ELEVATION (EAST)

2 SIDE ELEVATION (NORTH)

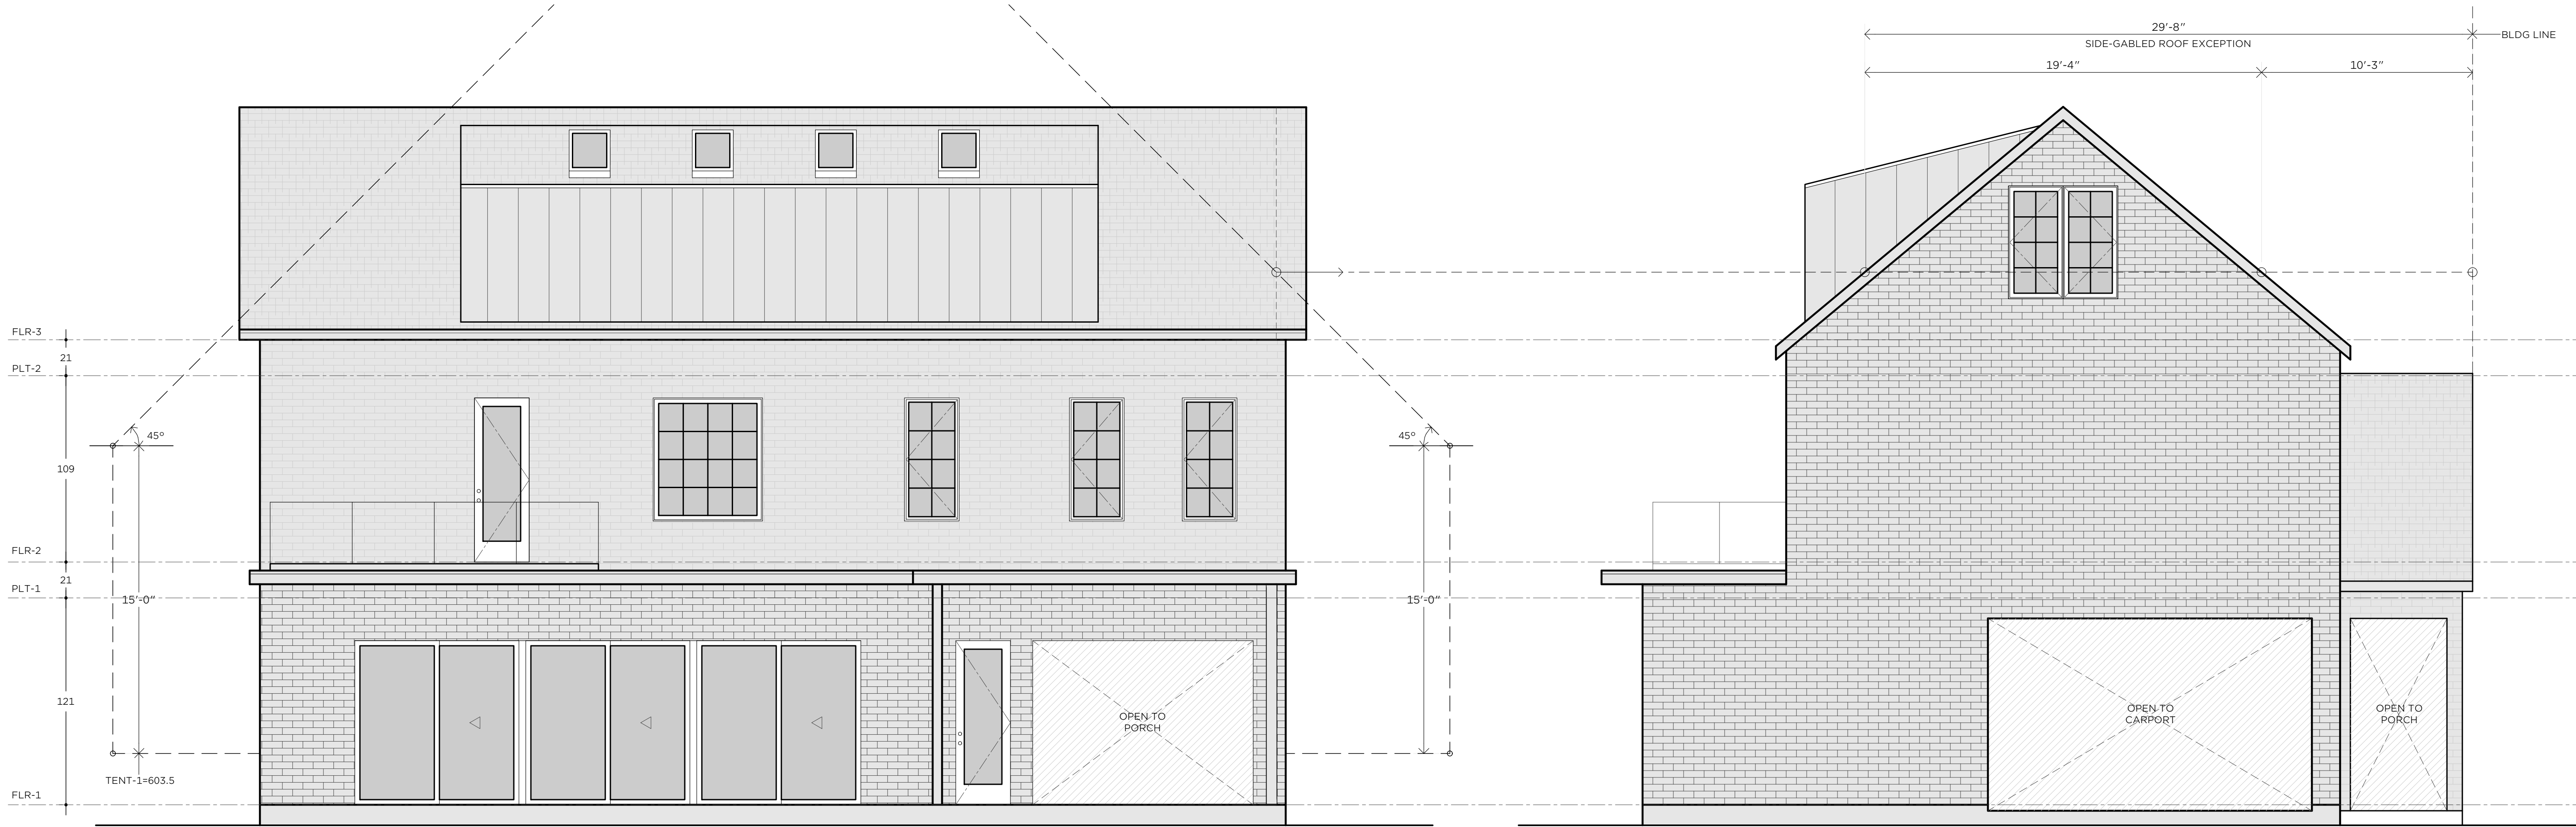

3 REAR ELEVATION (WEST)

4 SIDE ELEVATION (SOUTH)